

TLS-350R Point-of-Sale (POS)

Application Guide

Notice

Veeder-Root makes no warranty of any kind with regard to this publication, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose.

Veeder-Root shall not be liable for errors contained herein or for incidental or consequential damages in connection with the furnishing, performance, or use of this publication.

Veeder-Root reserves the right to change system options or features, or the information contained in this publication.

This publication contains proprietary information which is protected by copyright. All rights reserved. No part of this publication may be photocopied, reproduced, or translated to another language without the prior written consent of Veeder-Root.

©Veeder-Root 2006. All rights reserved.

Introduction	
BIR	1
ISD	1
Manifolded Tank Applications for BIR	1
TLS-350R System Components	
Magnetostrictive Probes	2
DIMs	2
DIM Installation Kits	2
Supported POS Systems	
Other Applications	3
DIM Descriptions	
Mechanical Dispenser Interface Module (MDIM) & Low Voltage Dispenser	
Interface Module (LVDIM)	4
Electronic Dispenser Interface Module (EDIM)	4
Current Loop Dispenser Interface Module (CDIM)	4
LAN Dispenser Interface Module (LDIM)	4
International Forecourt Standards Forum Dispenser Interface Module (IFSF)	4
TCP/IP DIM Module (TDIM)	5
DIM Installation Examples	7
Bennett POS System	
Veeder-Root Software Requirements	8
Veeder-Root Hardware Requirements	8
Bennett System Limitations	8
Installation Notes	8
Gilbarco TCRG, TCRG2, T-11, and T-12 POS Systems	
Veeder-Root Software Requirements	10
Veeder-Root Hardware Requirements	10
Specific Limitations	10
Wiring Diagram for a Transac Current Loop Interface	11
Wiring Diagram for an Excentus Current Loop Interface	12
Gilbarco TS-1000 POS and PAM Systems	
Veeder-Root Software Requirements	13
Veeder-Root Hardware Requirements	13
Gilbarco POS and Dispensing System Requirements	13
Specific Limitations	13
Wiring to a Universal Distribution Box Interface	14
Gilbarco G-Site™ POS Systems	
Veeder-Root Software Requirements	15
Veeder-Root Hardware Requirements	15
Gilbarco POS and Dispensing System Requirements	15
Specific Limitations	15
Wiring Diagram	16

AutoGas Storemaster and Gilbarco Dispenser Systems

- Veeder-Root Software Requirements 17
- Veeder-Root Hardware Requirements 17
- Gilbarco POS and Dispensing System Requirements 17
- System Limitations 17
- Installation Notes 17

Gilbarco SmartCrind Dispenser Systems

- Veeder-Root Software Requirements 22
- Veeder-Root Hardware Requirements 22
- System Limitations 22
- Installation Notes 22

Tokheim Dispensing Systems

- Veeder-Root Software Requirements 23
- Veeder-Root Hardware Requirements 23
- Tokheim DHC Requirements 23
- Specific Limitations 23
- Other POS Consoles 23
- Installation Notes 23

Wayne Dispensing Systems

- Veeder-Root Software Requirements 26
- Veeder-Root Hardware Requirements 26
- POS System Requirements and Limitations 26
- Supported Wayne Systems 26
- Supported Wayne POS Terminals 26
- Installation Notes 26

Schlumberger POS Systems

- Veeder-Root Software Requirements 28
- Veeder-Root Hardware Requirements 28
- System Limitations 28
- MicroMax/Allied Hardware Requirements 28
- Installation Notes 28

GasBoy CFN Systems

- Veeder-Root Software Requirements 31
- System software 349511-1XX-A, or 3XX-A (or higher) 31
- Veeder-Root Hardware Requirements 31
- GasBoy System Requirements for BIR Interface 31
- Connecting to the Site Controller II 31

BIR Protocol DIM 32

Mechanical Dispensers

- MDIM Applications 33
- LVDIM Applications 36
- Wiring to GasBoy 9800 or Tokheim 2600 Series Electronic Dispensers 37

Introduction

This guide provides assistance in selecting Dispenser Interface Modules (DIMs) that enable a TLS-350R Console with Business Inventory Reconciliation (BIR) and/or In-Station Diagnostics (ISD) capability to interface supported Point-of-Sale (POS) devices. This guide also specifies the kits required for each installation.

BIR

Business Inventory Reconciliation is an option that automatically collects dispensing data, in-tank inventories and deliveries, and reconciles the totals at the end of each shift, day, and month. When used with AccuChart™, further improvements in reconciliation accuracy are achieved by using metered sales data to calibrate the tank.

ISD

In-Station Diagnostics (ISD) is a comprehensive product that, in conjunction with the TLS-350R Console, monitors vapor recovery and Enhanced Vapor Recovery (EVR) systems at gasoline dispensing facilities.

General Requirements for BIR and ISD

TLS-350R with BIR only and TLS-350R with BIR and ISD

- Support up to 36 fueling positions
- Support up to 6 meters (hoses) per fueling position
- Support manifolded tanks
- Support blending dispensers that separately meter each product prior to blending. Gilbarco, Tokheim, and Wayne electronic blending dispensers are supported.
- Do not support dispensers that blend fuel prior to the metering process. Schlumberger electronic blending dispensers, and mechanical dispensers fitted with fixed-ratio ratios are not supported.

TLS-350R with ISD only

- Supports up to 36 fueling positions
- Supports up to 6 meters (hoses) per fueling position
- Supports manifolded tanks
- Supports all blending dispensers in this guide, including those in this guide labeled as not to be used with BIR.
- Must monitor all petrol fueling positions.
- Does not monitor diesel fueling positions.

Manifolded Tank Applications for BIR

The TLS-350R can perform automatic BIR on tanks in a siphon-manifolded set. However, to perform AccuChart, the following requirements must be met:

1. Maximum of 2 tanks in a set.
2. Maximum of 4 sets of siphon-manifolded tanks.
3. The combined tank capacity of a set shall not exceed 30,000 gallons.
4. The diameters of the tanks in a set shall not differ by more than 6 inches.
5. The manifolding method must be siphon, not line, manifolding.

Reconciliation reports will be generated for the manifolded set as a single product. Individual adjusted delivery reports will be provided followed by an adjusted manifolded delivery report.

Both Version 310 software (or later), and a Memory Expansion Module are required to perform BIR for manifolded tanks.

TLS-350R System Components

The following components are required to perform BIR:

- TLS-350R with automatic BIR
- Mag 1 (0.1 gph) magnetostrictive (standard or Mag Plus) probe
- A Dispenser Interface Module (DIM)
- A DIM installation kit
- ECPU board with the following software versions;
 - w/106 [or later] software for BIR,
 - w/311 [or later] software and a Memory Expansion Module for BIR with manifolded tanks, or
 - w/116 or 316 [or later] software for BIR with variance analysis

Magnetostrictive Probes

A Mag 1 probe is required for each tank that will be monitored and reconciled. The Mag 1 probe for alternative fuels is also supported.

DIMs

DIMs allow the TLS-350R to interface to most Gilbarco, Tokheim, Wayne, Schlumberger, and AutoGas POS terminals or dispensers. For electronic dispensers, one DIM is required for each TLS-350R. Up to 3 DIMs can be installed to support sites with multiple POS systems.

For mechanical dispensers, the TLS-350R can support up to 8 mechanical DIMs. Each mechanical DIM supports up to 4 mechanical dispensers.

DIM Installation Kits

One installation kit may be required for each DIM (ref. Table 1, "DIM and Installation Kit Ordering Guide," on page 5). The installation kits vary for each DIM and include all required adapter boxes and cables.

Supported POS Systems

The TLS-350R console can interface to many POS terminals as well as the Veeder-Root mechanical dispenser. This guide provides specific information on each application. The supported POS systems are:

Manufacturer	POS/Dispensing System
Gilbarco	TCRG, TCRG2, T-11, T-12, TS-1000, PAM, G-Site, Passport, Storemaster, SmartCrind, ANDI, CFN2, Excentus
Tokheim	MEMS IV, MEMS V, Vision 100/200, DHC with all other POS, CFN2, ANDI, Columbus, Schlumberger MicroMax XPIC/DHC, 67/A - 98, 67/B
Wayne	Wayne Site Controller, Excentus, ANDI, IDPOS
Schlumberger	MicroMax/Pro series, MicroMax/Allied, SAM/XPIC, ANDI
GasBoy	CFN2 & ProfitPoint, CFN1, ANDI
Bennett	92D
Mechanical, Mechanical noncomp, or Mechanical V-R meter	CFN2, Petrovend, ANDI

Other Applications

Many POS / dispenser systems are similar to those identified in this guide. Veeder-Root is constantly evaluating and supporting new applications. If your application is not listed in this guide, contact your Veeder-Root Sales Representative.

DIM Descriptions

Mechanical Dispenser Interface Module (MDIM) & Low Voltage Dispenser Interface Module (LVDIM)

- The mechanical dispenser interface modules enable the TLS-350R console to monitor either high voltage (MDIM), or low voltage (LVDIM) volume pulses and calculate dispensed volume.
- MDIMs have 8-pin and LVDIMs have 10-pin external rectangular connectors.

Electronic Dispenser Interface Module (EDIM)

- Installs in a communication port of TLS-350R. EDIMs are used to communicate via RS-232 to point of sale or system controllers.
- More than one EDIM can be installed in any combination with other DIM types.
- EDIMs have one 25-pin D connector outside of the port.
- Red and green LEDs are on this board. When red LED is turned On, EDIM is transmitting to external device; when green LED is turned On, external device is transmitting to EDIM.

Current Loop Dispenser Interface Module (CDIM)

- Installs in a communication port of TLS-350R. Various CDIM monitoring applications include current loop, RS-232, and RS-422.
- More than one CDIM can be installed in combination with other DIM types.
- CDIMs have three RJ-45 modular connectors.
- CDIMs cannot transmit to external device.
- Connects via 4-wire cable to cable adapter box. Adapter box converts target communication format to RS-422 format for CDIM. Adapter boxes are configured with 2-wire flying leads, 25-pin D or 9-Pin D, T-cable connectors for various applications.

LAN Dispenser Interface Module (LDIM)

- Installs in a communication port of TLS-350R to communicate with or monitor POSs, dispensers or system controllers using RS-485 communication standard.
- An LDIM can be installed in combination with other DIM types.
- LDIMs have a 5-wire phoenix connector.
- Red and green LEDs are on this board. When red LED is turned On, LDIM is transmitting to external device; when green LED is turned On, external device is transmitting to LDIM.
- Can be used in 4-wire or 2-wire, RS-485 and RS-422 applications.
 - DIP switch default in OPEN position, loopback jumper on LED side for RUN mode
 - R1 - 331076-001 - RS-485 two wire
 - R2 - 331076-002 - RS-422 four wire
 - R3 - 331076-003 - DIM RS-485 two wire (install in TLS-350R only)
 - R4 - 331076-004 - DIM RS-422 four wire (install in TLS-350R only)

International Forecourt Standards Forum Dispenser Interface Module (IFSF)

- Required for TLS Consoles that are connected to IFSF networks.
- Uses Echelon 2-wire FTT10-A medium, as defined by the IFSF standards.
- There are 3 LEDs on this board:
 - Green LED On when IFSF board is transmitting information to the TLS.
 - Red LED On when TLS is transmitting information to the IFSF board.
 - Amber LED Off indicates normal state of the IFSF board processor.
- There are no LED indicators for network communication.

TCP/IP DIM Module (TDIM)

- Installs in a communication port of the TLS-350R to communicate with or monitor the Wayne IDPOS dispenser.
- Minimum system requirements for TDIM Module operation:
 - Console system software: Version 15 or higher - Version 21 or higher is recommended
 - Network connection to a PC requires a hub. Connecting to a hub requires a straight CAT 5 cable
 - Direct connection to a PC requires an ethernet crossover cable
 - Connection to a LAN or WAN
- There are 2 LEDs on the PC board of this module:
 - Green LED indicates that the TDIM module is transmitting information to the TLS.
 - Red LED indicates the TLS is transmitting information to the TDIM module.
- There is no communication alarm for this module.

Table 1. DIM and Installation Kit Ordering Guide

Dispenser	Dispenser Controller / POS Type	DIM P/N w/console	DIM Install Kit P/N	Notes
Bennett	92D	330404-040	848705-XXX	For Bennett 92D controllers. DIM kit has 2 CABs in it. One CAB is needed per current loop. Only one or two dispensers are on one current loop.
Gasboy	CFN2 & Profit Point	331001-003	331088-XXX	A Gasboy site controller version 2.0 or later is required. A Gasboy junction box Gasboy part # C05020 should be ordered for installation. No Blending ¹ . Network POS Required.
	ANDI	330280-001	None required	Allied ANDI. Gilbarco dispenser with T-14 (Australia). PEC with 8850. POSTEC with RCC. Wayne with Marketer 2000 (Sweden).
	CFN1	331001-002	331088-XXX	This is a TLS-350 RS-422 interface to the Network. NOT to be used for BIR or ISD applications.
Gilbarco	TCRG	330404-020	848702-XXX	Model TCRG PA0180-121
	TCRG2			Model TCRG2 PA0180-121
	T-11			Model T-11 PA0132-XXXX and PA0141-XXXX
	T-12			Model T-12 PA0188-XXXX
	Excentus			Excentus Dispenser Tank Monitor Interface Kit (Excentus P/N 080-Veeder Root Kit) is required.
	TS-1000	330404-020	848722-XXX	One kit is needed per dispenser current loop.
	PAM			For controller with a RS-485 Distribution Box, use kit P/N 848741-XXX.
	G-Site	330280-401	331063-XXX	To support this DIM and the TLS-350R, the G-site must be upgraded to include the EMC interface. Uses Controller types C2, C15, 486 and Pentium Site controllers.
	Passport			Verify BIR protocol is version C
	Storemaster	330404-020	848741-XXX	One Gilbarco Dispenser Distribution Box PA0133000 should be available. Up to 12 Highliner/MPD Fueling positions are supported. An Auto-gas Storemaster POS and Autogas 507 controller are required.
	SmartCrind	330020-538	None required	TCPIP Interface for Gilbarco SmartCrind dispensers only. Wal-Mart is currently the only customer ordering this interface for this dispenser.
	ANDI	330280-001	None required	Allied ANDI. Gilbarco with T-14 (Australia). PEC with 8850. POSTEC with RCC. Wayne with Marketer 2000 (Sweden)
	CFN2	331001-003	331088-XXX	A Gasboy site controller version 2.0 or later is required. A Gasboy junction box Gasboy part # C05020 should be ordered for installation. Single product dispensers only. No Blending ¹ .

¹This restriction does not apply to ISD only installations.

Veeder-Root POS Application Guide

Dispenser	Dispenser Controller / POS Type	DIM P/N w/console	DIM Install Kit P/N	Notes
Mechanical	CFN2	331001-003	331088-XXX	A Gasboy site controller version 2.0 or later is required. A Gasboy junction box Gasboy part # C05020 should be ordered for installation. Single product dispensers only. No Blending ¹ . Network POS required.
Mechanical, Mechanical non-comp, or Mechanical V-R meter	Petrovend	331313-001	None required	One or more pulser/totalizer kits are needed PN 787491-003. Each mech DIM supports up to 4 mech dispensers. Up to 8 may be installed in the high power compartment of the TLS-350R. Other modules installed will reduce the number of slots available.
	None			One or more pulser/totalizer kits are needed, P/N 7874911-003. Each mech DIM supports up to 4 mech dispensers. Up to 8 may be installed in the high power compartment of the TLS-350R. Other modules installed will reduce the number of slots available.
	ANDI	330280-001		Allied ANDI. GilbarcoDispenser with T-14 (Australia). PEC with 8850.POSTEC with RCC. Wayne with Marketer 2000 (Sweden).
Schlumberger	MicroMax/ Pro series	330404-001	848731-XXX	Schlumberger MicroMax or Pro series supported. Schlumberger X-PIC contr and Schlumberger disp required. Schlumberger SAM contr or Highway systems not supported by this DIM. Blending is supported.
	MicroMax/ Allied		848711-XXX	An Allied site cont or Tok DHC with Tok disp is req. Only Schlumberger MicroMax POS consoles are supported. POS terms other than the MM are NOT supported. Any make disp supported by Allied box will be supported by TLS-350R. Schlumberger disp not required. No Blending ¹ .
	SAM/XPIC	330404-002	848731-XXX	SAM or Schlumberger XPIC controller with Schlumberger MicroMax POS consoles required. POS terms other than the MM are NOT supported. Schlumberger disp not required. No Blending ¹ .
	ANDI	330280-001	None required	Allied ANDI. Gilbarco with T-14 (Australia). PEC with 8850. POSTEC with RCC. Wayne with Marketer 2000 (Sweden).
Tokheim	MEMS IV, MEMS V, Vision 100/ 200, and DHC with all other POS	330280-201 (This DIM is being phased out. Use 331354-001 instead.)	331390-XXX	A Tokheim Dedicated Hose Controller (DHC) is required, and should have software version 5.6 dated 11/89 or later.
	CFN2	331001-003	331088-XXX	A Gasboy site controller version 2.0 or later is required. A Gasboy junction box Gasboy part # C05020 should be ordered for installation. Single product dispensers only. No Blending ¹
	ANDI	330280-001	None required	Allied ANDI. Gilbarco dispenser with T-14 (Australia). PEC with 8850. POSTEC with RCC. Wayne with Marketer 2000 (Sweden).
	Schlumberger Micro-max XPIC/DHC	330404-001	848751-XXX	A Tokheim DHC or Schlumberger XPIC with Tokheim dispensers and Schlumberger MicroMax POS consoles are required. POS terminals other than the MicroMax are NOT supported. No Blending ¹
	67/A - 98	331354-001	331391-XXX	Tokheim controller only.
	67/B		848744-XXX	Tokheim controller only.
	Columbus	330280-001	None required	For Rockport cable kits order Quantity (2) 320449-18 from Tokheim. For Digi/Stargate order Quantity (2) 320449-9 Cable kits from Tokheim.
Wayne	Wayne Site Controller	330404-010	848703-XXX	A Wayne site controller and Wayne dispensers are required. Any POS may be connected to the Wayne site controller. All Wayne electronic blenders are supported prior to Nucleus.
	ANDI	330280-001	None required	Allied ANDI. Gilbarco dispenser with T-14 (Australia). PEC with 8850. POSTEC with RCC. Wayne with Marketer 2000 (Sweden).
	Excentus	330404-010	848702-XXX	Excentus Dispenser Tank Monitor Interface Kit (Excentus P/N 080-Veeder Root Kit) is required.
	IDPOS	330020-501	None required	TCPIP interface for Wayne IDPOS dispensers only

¹This restriction does not apply to ISD only installations.

DIM Installation Examples

Various example DIM installation diagrams are shown in Figure 1 below for reference only. For specific DIM installation details, refer to the appropriate Veeder-Root DIM installation manual.

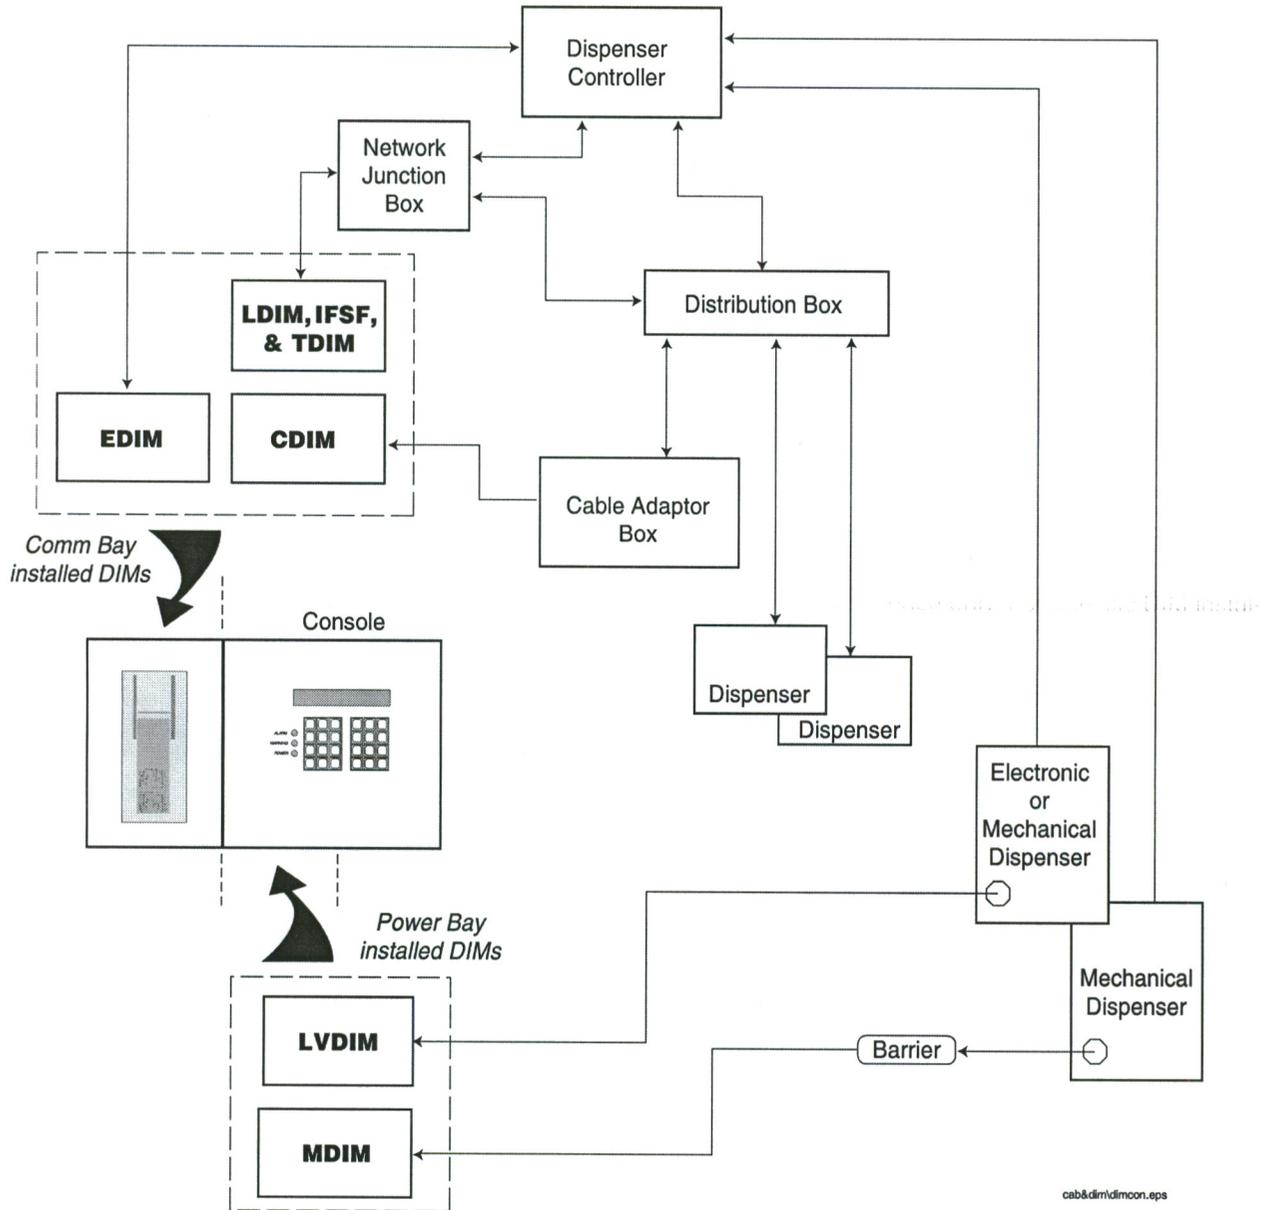


Figure 1. Simplified DIM Connections to various Dispensing Systems

Bennett POS System



The information collected via the interface allows TLS-350R business inventory reconciliation to compare tank totals to fuel transactions for end of day, end of shift, or end of month, running variances.

Veeder-Root Software Requirements

- System software Version 17 (or higher)
- Peripheral controller software 330269-00B (or later)
- DIM software 349780-001A (or later)

Veeder-Root Hardware Requirements (see Table 1 on page 5)

The following equipment is required to interface the TLS to the Bennett POS system:

- One Bennett Current Loop Dispenser Interface Module for up to 6 fueling positions
- One installation kit (for every 2 current loops (up to 12 fueling positions))

Bennett System Limitations

TLS-350R with BIR and TLS-350R with BIR and ISD

- Only non-blending, type 92D dispensers with Orpak controllers are supported.

TLS-350R with ISD

- All type 92D dispensers with Orpak controllers are supported.

Installation Notes

The interface to Bennett dispensing equipment requires one CAB per dispenser current loop (for up to 6 fueling positions) and one Bennett DIM installation kit for every 2 current loops. Typically one or two loops are required for a single dispenser having two fueling positions. For this reason the interface kit includes two CABs with supportive cabling. Supportive cabling required is sold in lengths, which are identified in the last three digits of the kit form number. The length requirement is determined by the distance between the components.

Below is an example Bennett dispenser connection diagram (see Figure 2). Each CAB has a three position input and a RJ-45 cable output to a dispenser loop. Use the "PUMP COMM" input side and the RJ-45 cable output.

Figure 2: Bennett Dispenser Connection Diagram

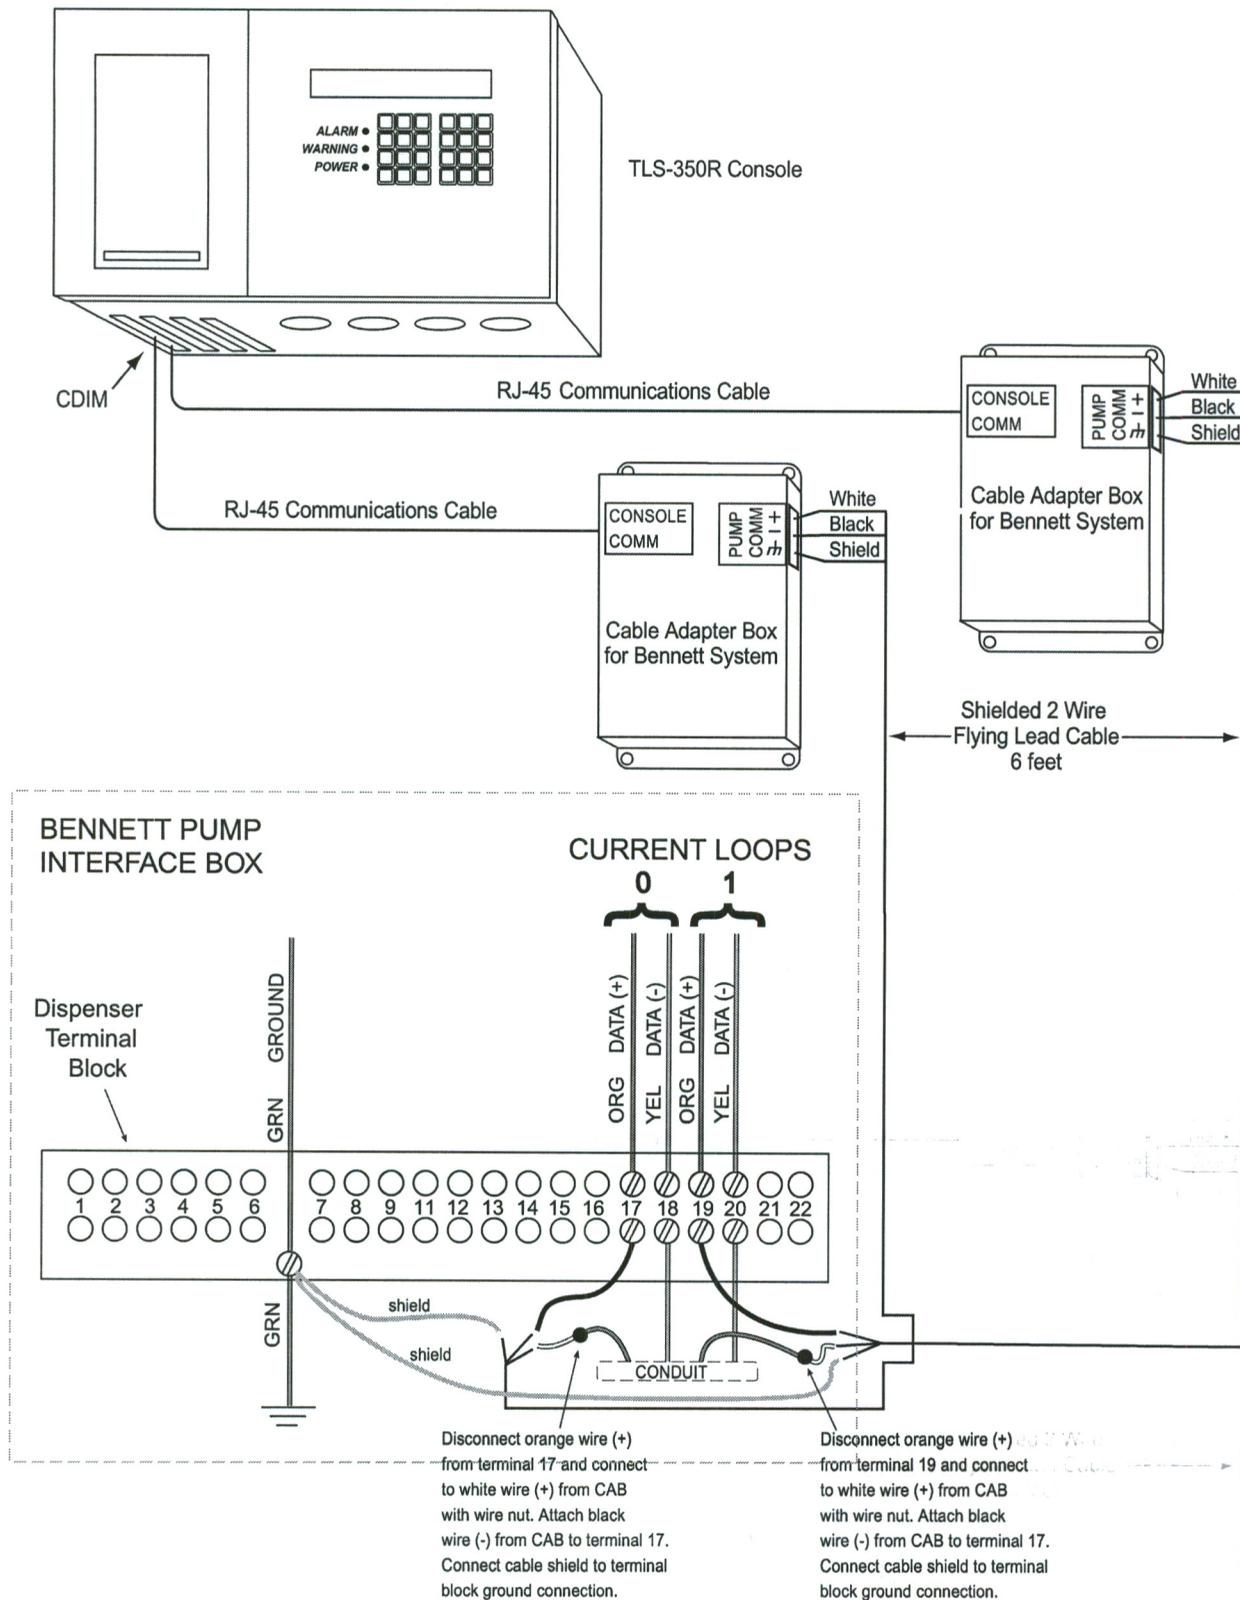


Figure 2. Bennett Pump Fuelomat Dispenser Interface Installation Diagram

Gilbarco TCRG, TCRG2, T-11, and T-12 POS Systems

Veeder-Root Software Requirements

- System software Version 17 (or higher)
- Peripheral controller software 002B (or later)
- DIM software 349634-003C (or later)

Veeder-Root Hardware Requirements (see Table 1 on page 5)

The following equipment is required to interface the TLS to the Transac POS:

- One Gilbarco Current Loop Dispenser Interface Module for up to 3 current loops
- One Gilbarco dispenser distribution box PA0133000
- One Gilbarco Transac DIM installation kit required per current loop. Up to 16 fueling positions are supported per current loop.

The following POS consoles are supported:

- Transac-11 (PA0132, PA0141)
- Transac-12 (PA0134, PA0142)
- Transac-12A (PA0151, PA0152)
- Transac-12B (PA0173)
- Transac-12C (PA0188)
- Transac-12G (PA0203)
- TCRG (PA0180-121)
- TCRG2 (PA0180-121)
- Excentus Reward Fuel Controller™, Gilbarco Dispenser Interface, V1.0.160

Specific Limitations

Only Gilbarco electronic dispensers are supported. Also, dispensers that feature a blender and a single-product dispenser at one fueling position are not supported.

In-Dispenser credit card readers (CRINDS) or G-Site systems are not supported by the Gilbarco CDIM.

Other POS systems that use Gilbarco dispensers and the Gilbarco Pump Access Module (PAM) may also be supported - contact Veeder-Root for assistance.

Special Note on T-11/T-12 Pre-Pay Applications

In T-11/T-12 Pre-Pay applications, cashiers should be urged to close out each transaction promptly. Failure to close-out promptly can cause the TLS-350R to delay reconciliation reports, and impact the system's ability to maximize tank calibration.

Wiring Diagram for a Transac Current Loop Interface

A PA0133 distribution box is shown in Figure 3 below. Other box models are slightly different.


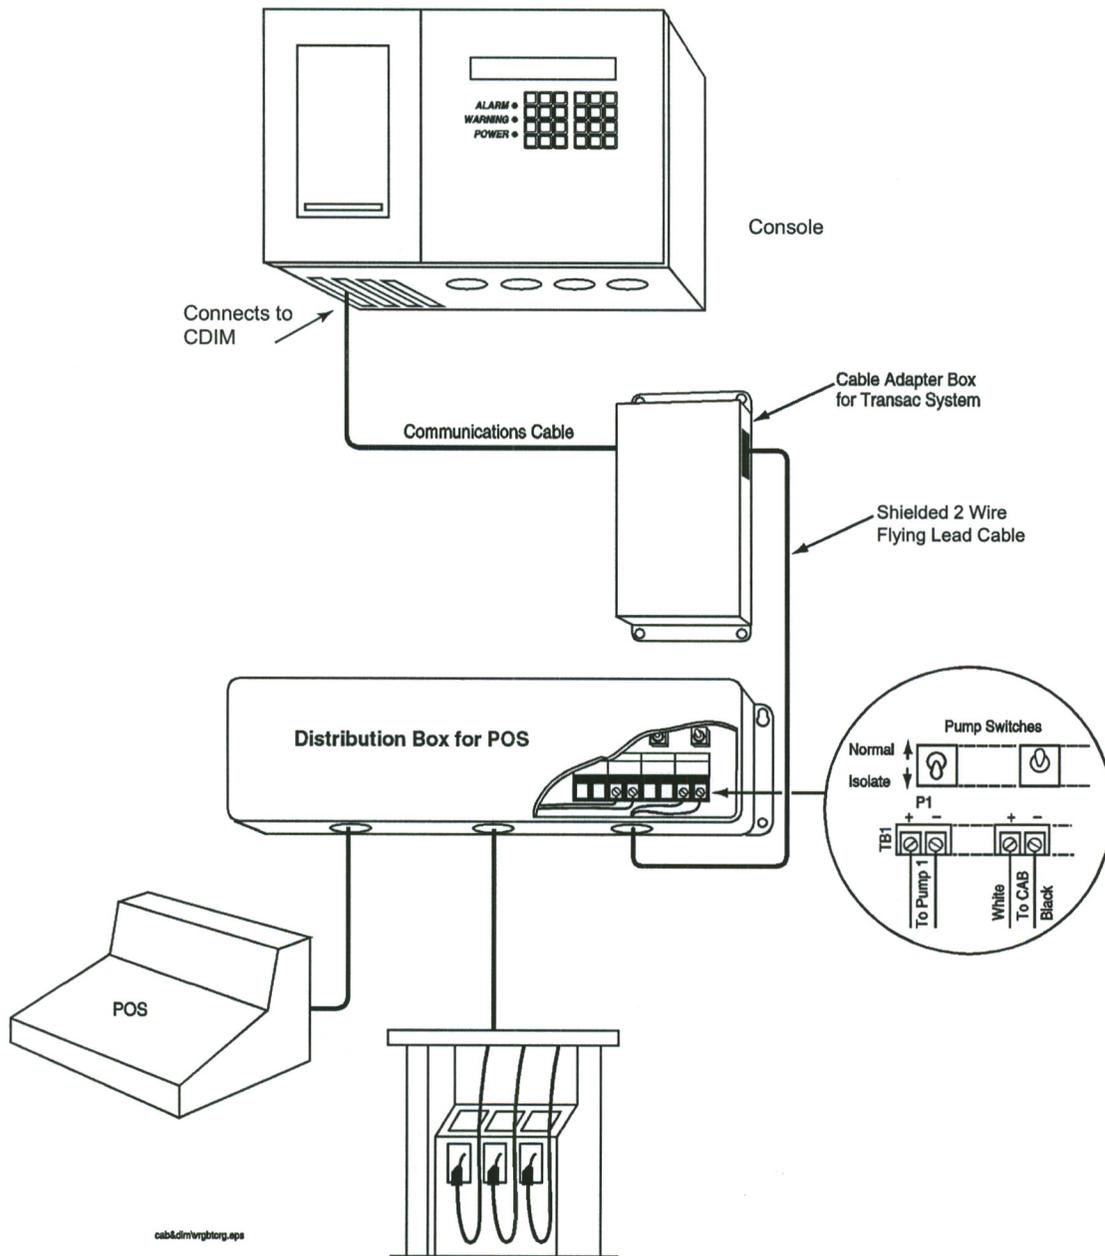


Figure 3. Transac Series Current Loop Interface

Wiring Diagram for an Excentus Current Loop Interface

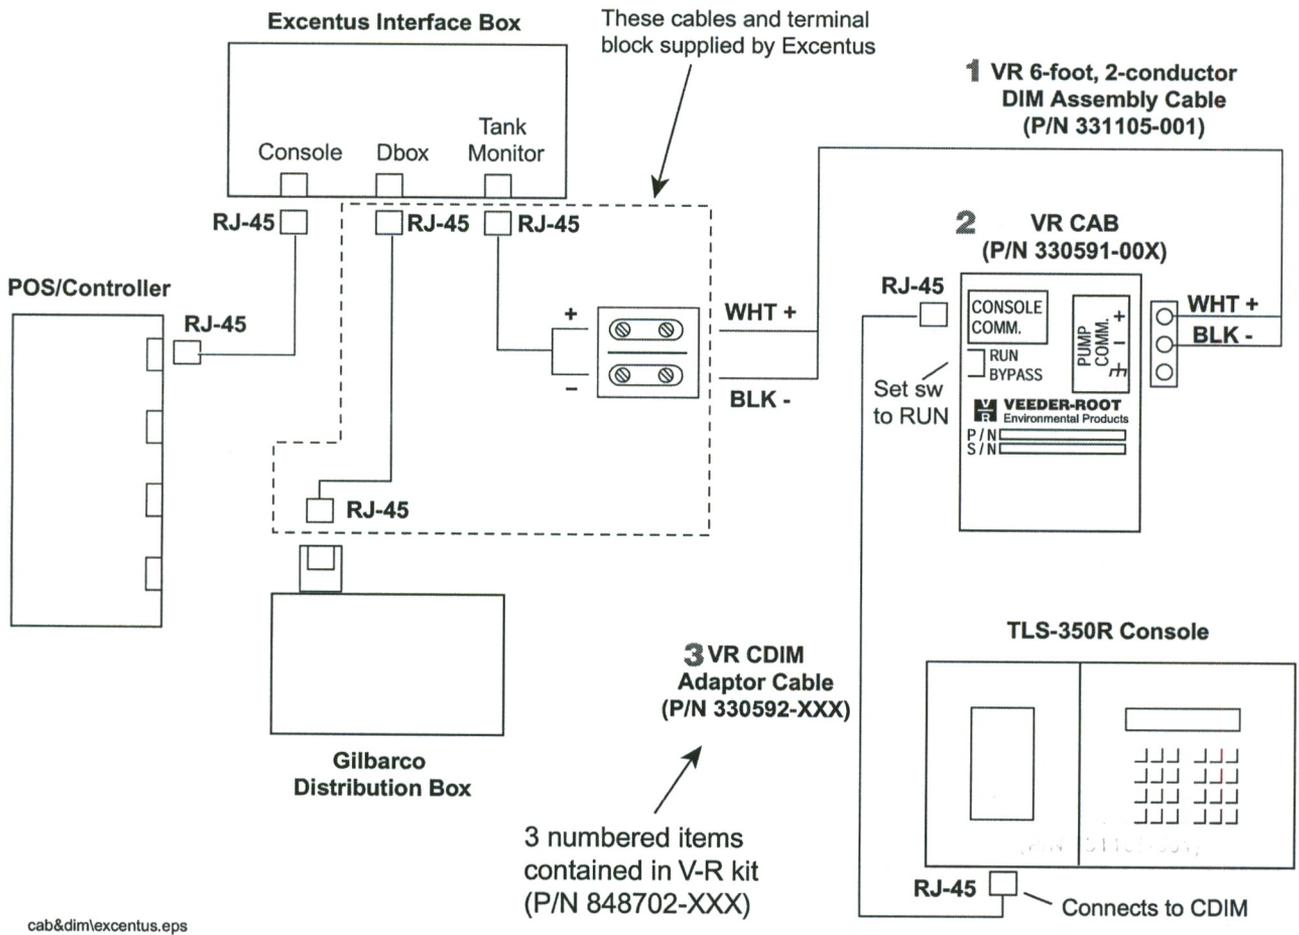

cab&dim/excentus.eps

Figure 4. Excentus Current Loop Interface

Gilbarco TS-1000 POS and PAM Systems

The Veeder-Root Gilbarco TS-1000 DIM and DIM installation kit supports the Gilbarco TS-1000 and any POS system using the Gilbarco PAM (Pump Access Module) dispenser controller and Gilbarco dispensers.

Veeder-Root Software Requirements

- System software Version 17 (or higher)
- DIM software 349634-003C (or later)

Veeder-Root Hardware Requirements (see Table 1 on page 5)

The following equipment is required to interface the TLS to the TS-1000 POS:

- One Gilbarco Current Loop Dispenser Interface Module for up to 3 current loops
- One installation kit for each current loop

Gilbarco POS and Dispensing System Requirements

- Gilbarco dispenser distribution box, PA0242000000
- Gilbarco dispenser distribution box, PA0261000010
- Gilbarco dispenser distribution box, PA0261000020
- Gilbarco pump controller, model PA0241000000
- Gilbarco Transac System 1000 Console, model PA0240000000
- Gilbarco Transac System 1000 Console, model PA02400001010
- Excentus Reward Fuel Controller™, Gilbarco Dispenser Interface, V1.0.160 (Excentus P/N 080 - Veeder Root Kit) is required.

Specific Limitations

- Up to 48 Gilbarco single product or blending dispenser fueling positions are supported. Dispensers that feature a blender and a single-product dispenser at one fueling position are not supported.
- Only Gilbarco dispensers are supported.
- In-dispenser credit card readers in these POS systems are not supported by the Gilbarco Current Loop Dispenser Interface Module.
- The Gilbarco Current Loop Dispenser Interface Module does not support Gilbarco G-Site applications.

Wiring to a Universal Distribution Box Interface

The diagram in Figure 5 is a typical interconnection diagram for a PAM or Transac System 1000 interface (a PA0261 distribution box is shown, the PA0241 is slightly different).

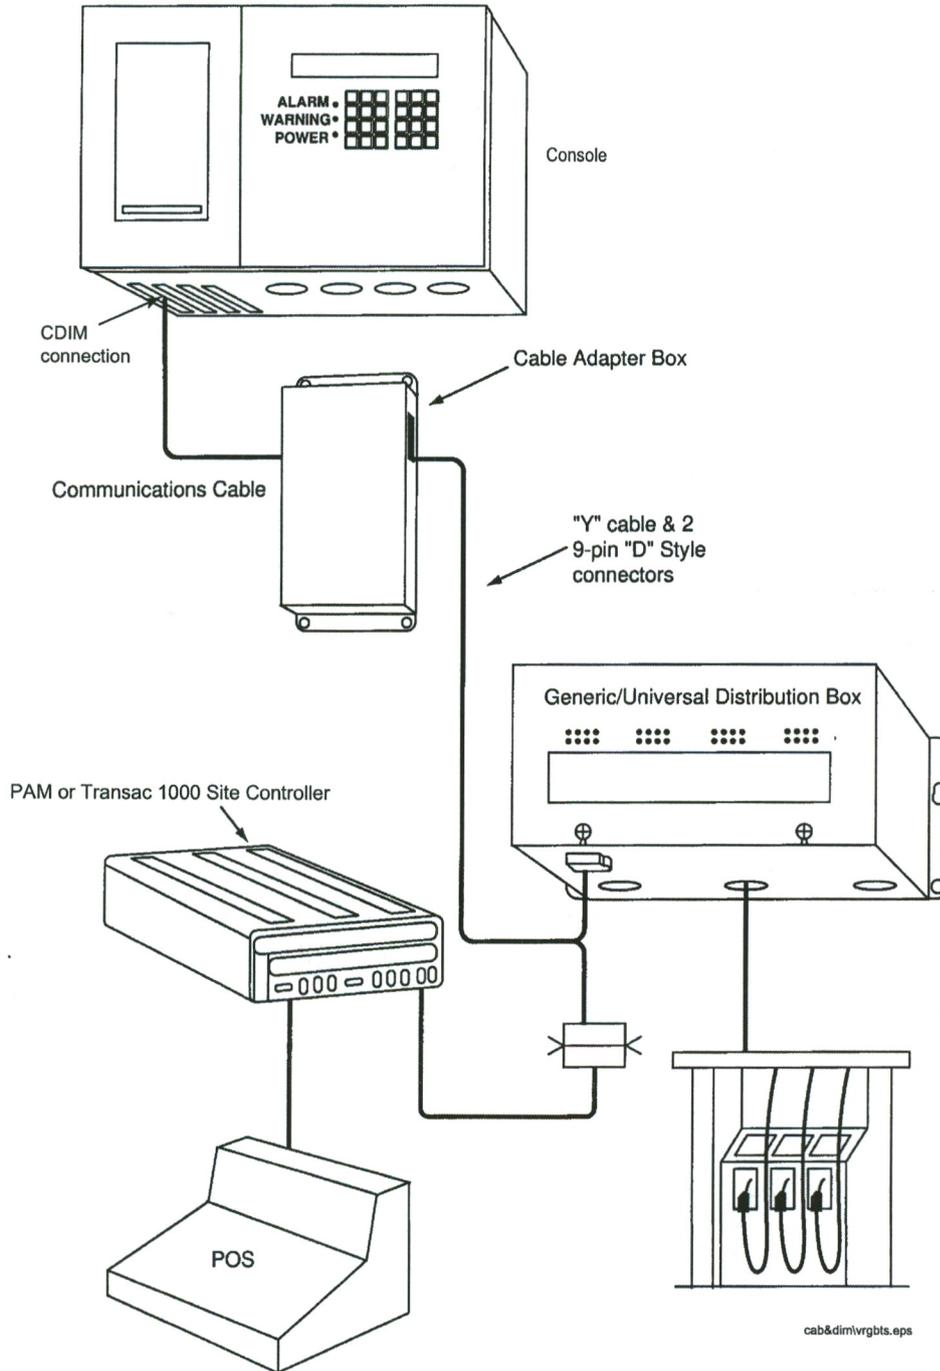


Figure 5. Universal Distribution Box Interface

Gilbarco G-Site™ POS Systems

Veeder-Root Software Requirements

- System software Version 17 (or higher)
- DIM software 349634-003C (or later)

Veeder-Root Hardware Requirements (see Table 1 on page 5)

The following equipment is required to interface the TLS to the G-Site POS:

- One Gilbarco Interface Module
- One installation kit for each current loop

Specific Limitations

Up to 36 Gilbarco Uni-Hose/MPD fueling positions are supported.

In-dispenser credit card readers (CRINDS) are supported.

To support a DIM and the TLS-350R, the G-Site must be upgraded to include EMC interface capability. This has been released in the following G-Site versions (EMC Interface capability will be released into the Generic G-Site version 6):

- Exxon - version 25.0.243
- Shell - version 33.1.23
- Chevron Canada - version 8.1.10

The 331063-xxx installation kit contains two gender mender adapters. One gender mender is used for PC G-SITE applications while both are used for C-2 G-SITES. The gender mender adapters are not identical. As shown in Figure 6, be sure to use the correct part at the connection points for your particular installation.

Wiring Diagram

G-Site wiring examples are shown in Figure 6 below:

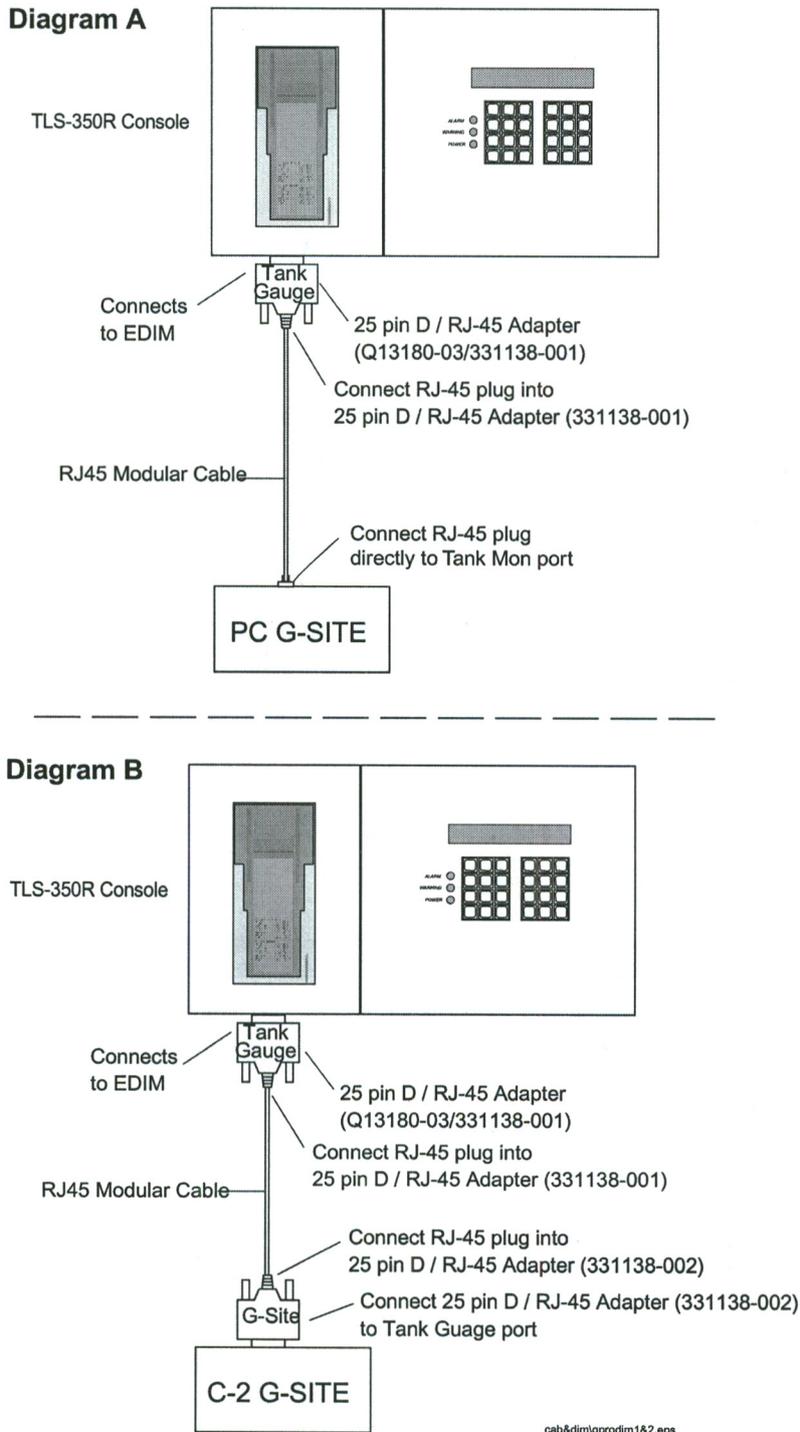


Figure 6. Example G-Site Installations

AutoGas Storemaster and Gilbarco Dispenser Systems

Veeder-Root Software Requirements

- System software Version 17 (or higher)
- DIM software 349634-003C (or later)

Veeder-Root Hardware Requirements (see Table 1 on page 5)

The following equipment is required to interface the TLS to the AutoGas Storemaster system:

- One Gilbarco Interface Module (for up to 3 current loops)
- One installation kit for each current loop other than RS-422/RS-485 OR One Gilbarco installation kit for each RS-422/RS-485 current loop

Gilbarco POS and Dispensing System Requirements

- Gilbarco Dispenser Distribution Box PA-2420000000
- Gilbarco Dispenser Distribution Box PA02610000010
- Gilbarco Dispenser Distribution Box PA02610000020
- Gilbarco Dispenser Distribution Box PA0281XXXXXX0

An AutoGas 507 controller is required with the AutoGas Storemaster POS.

System Limitations


- Up to 36 Gilbarco single product or blending fueling positions are supported.
- Only Gilbarco dispensers are supported.
- The Gilbarco current loop dispenser interface module does not support Gilbarco G-Site applications.

The Cable Adaptor Box install kits are designed to be installed on either a Gilbarco 2-wire distribution box input using 9-pin 'D shell' style connectors or a Gilbarco RS-422/RS-485 input to the distribution box, also using 9-pin 'D shell' style connectors.

To identify the distribution input communication type, refer to the Gilbarco Universal Distribution Box Installation Manual (MDE2713) noting the position choices for jumper 12 and 10 on the Universal Distribution Box Card which is communicating to the PAM, POS, or computer controlling the hydraulic dispenser status. Both of these jumpers should be in the horizontal position. (If vertical, the pump input is RS-422 and that kit should be used [see Table 1 on page 5]).

Installation Notes

Example wiring diagrams are shown in Figure 7 to Figure 10 below.

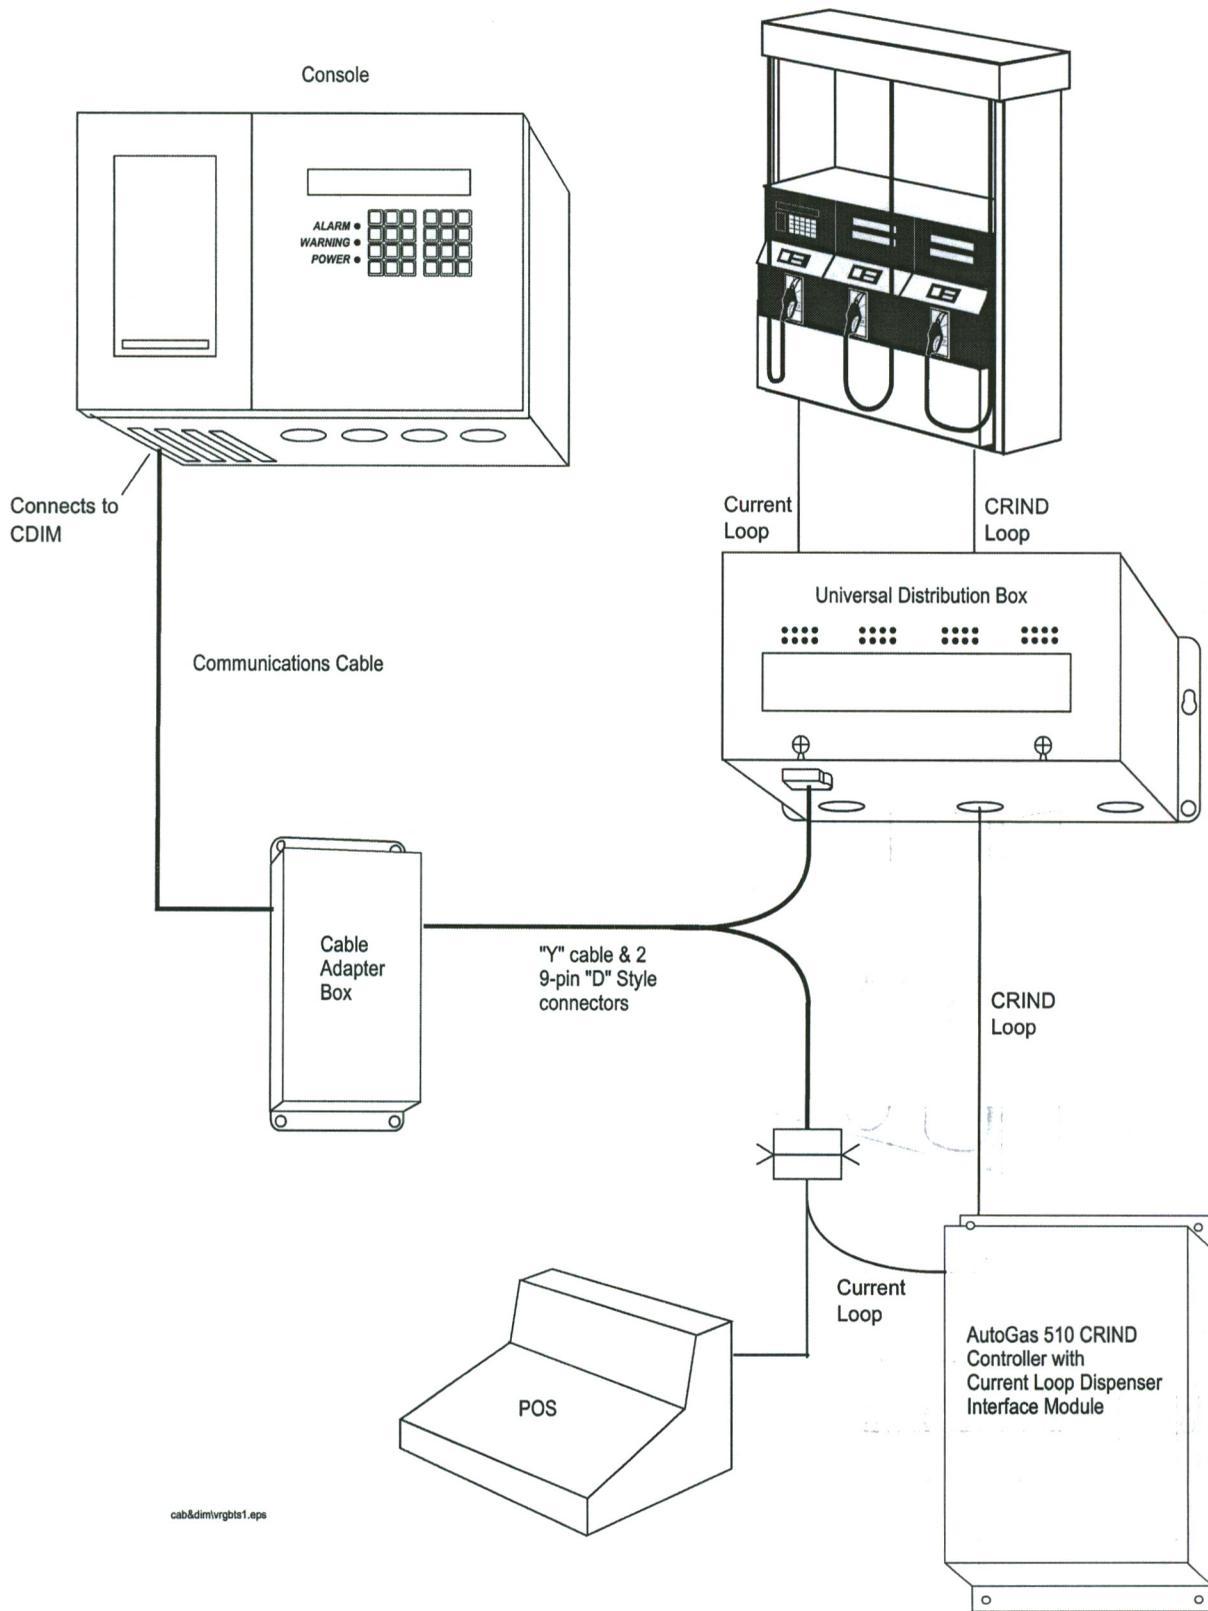

cab&dimivr01s1.eps

Figure 7. AutoGas 510 CRIND Controller with Current Loop Interface



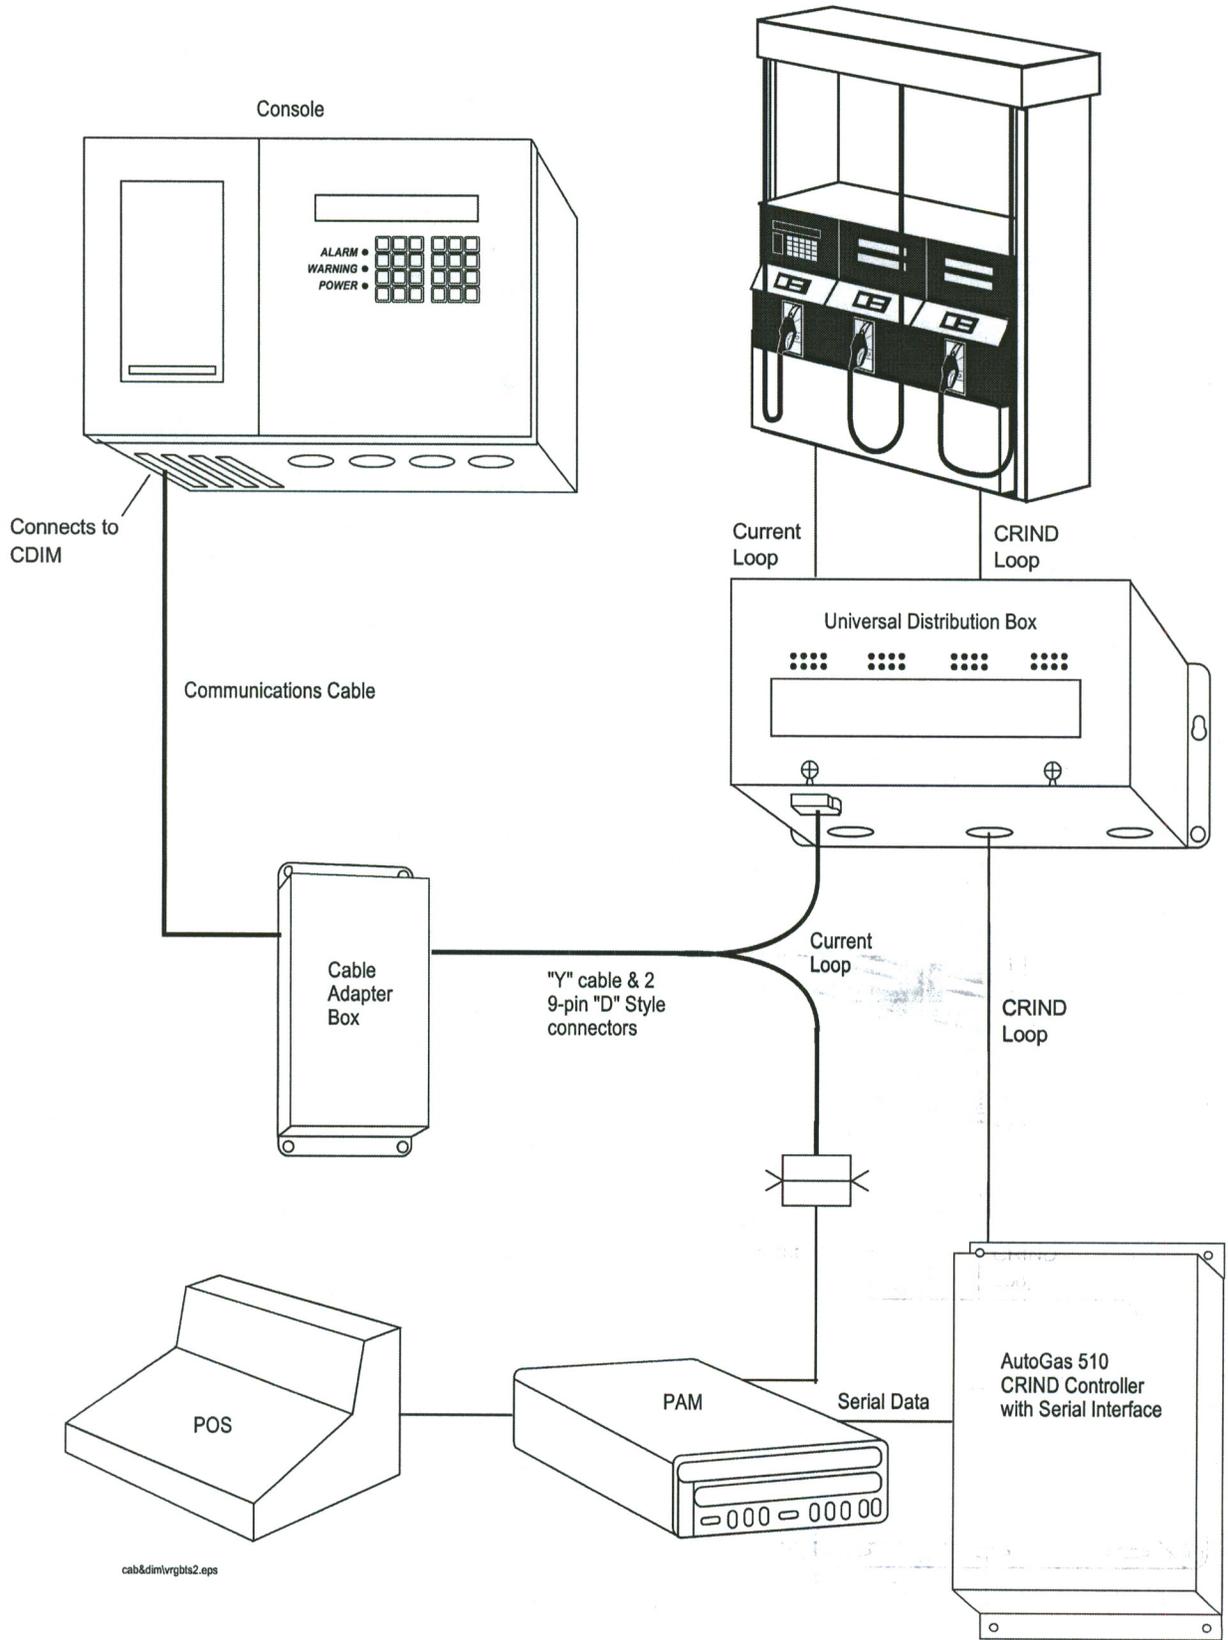


Figure 8. AutoGas 510 CRIND Controller with Serial Interface

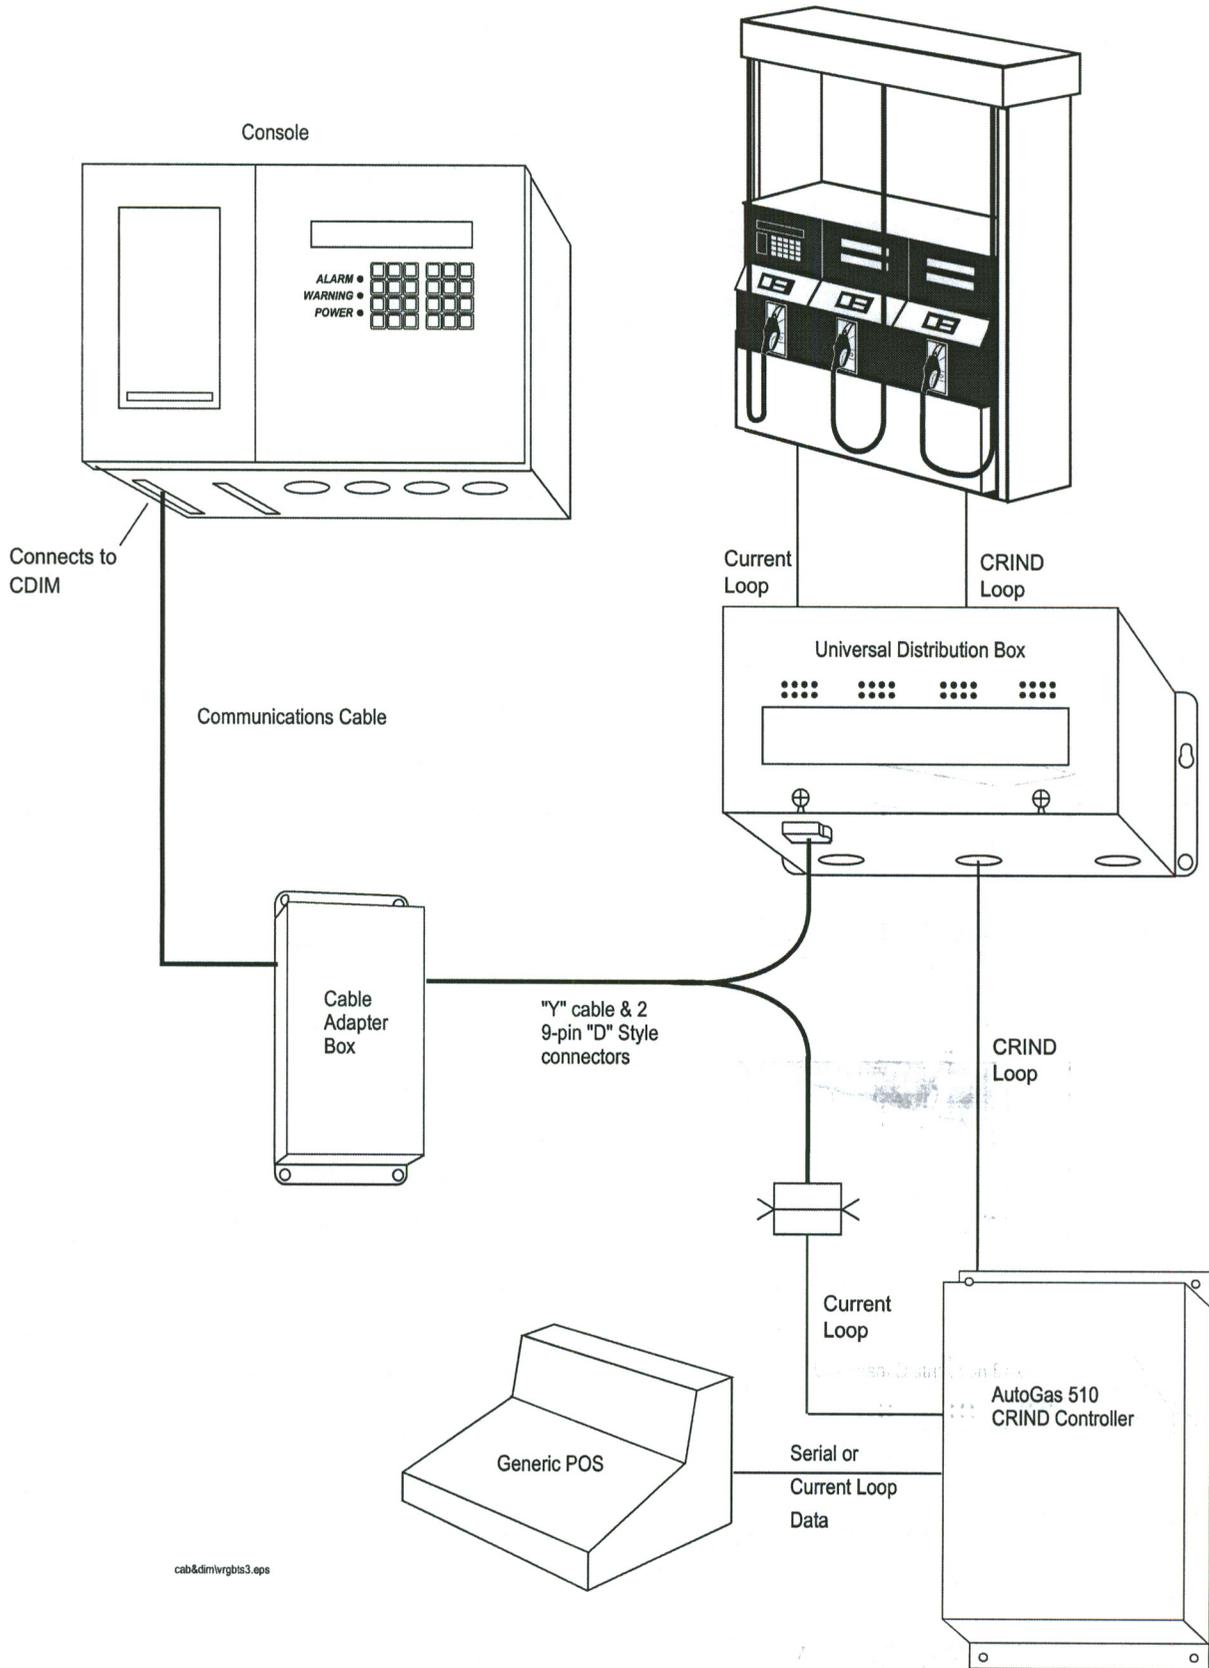

cab&dim/vrgbis3.eps

Figure 9. AutoGas 510 CRIND Controller

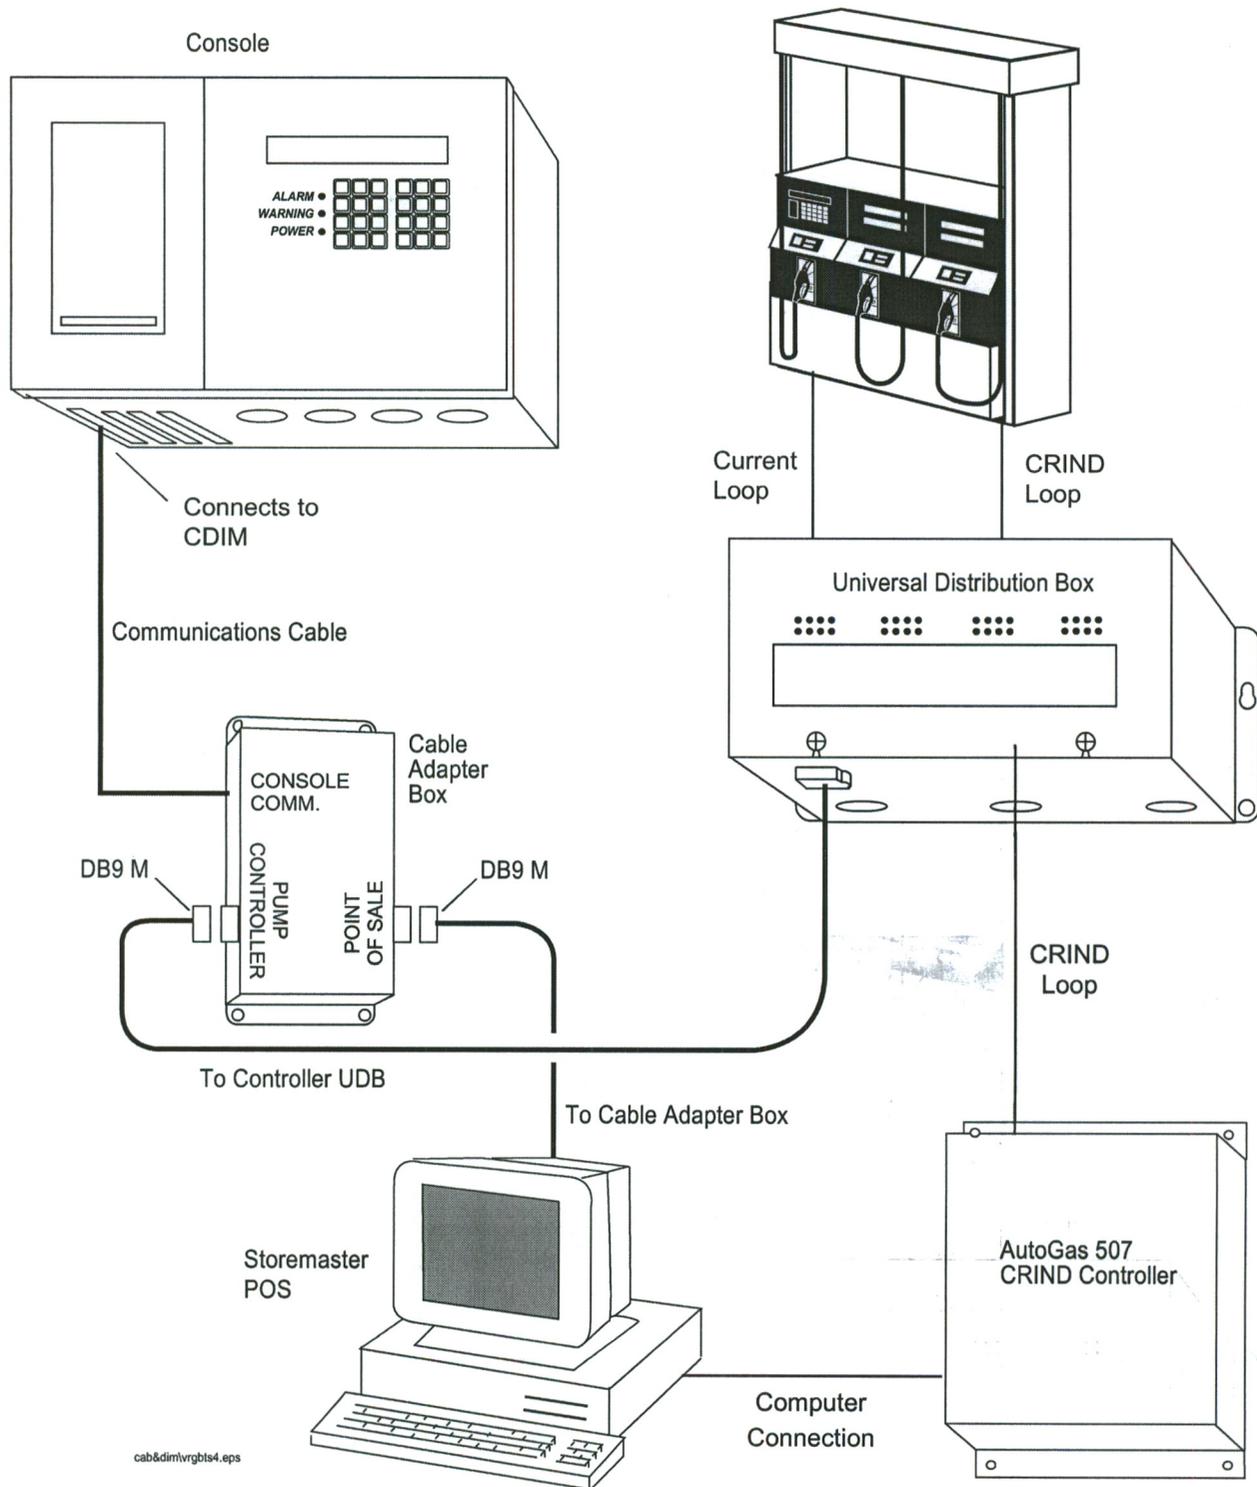

cab&dim\vrqbt4.eps

Figure 10. AutoGas 507 CRIND Controller

Gilbarco SmartCrind Dispenser Systems

Veeder-Root Software Requirements

- System software Version 17 (or higher)
- DIM software 349806-001B(5)

Veeder-Root Hardware Requirements (see Table 1 on page 5)

The following equipment is required to interface the TLS to the SmartCrind network:

- One TCP/IP (TDIM) Interface Module
- Ethernet cable

System Limitations

- Up to Gilbarco single product or blending fueling positions are supported.
- Only Gilbarco SmartCrind dispensers are supported.

Installation Notes

Example wiring diagrams are shown in Figure 11 below.

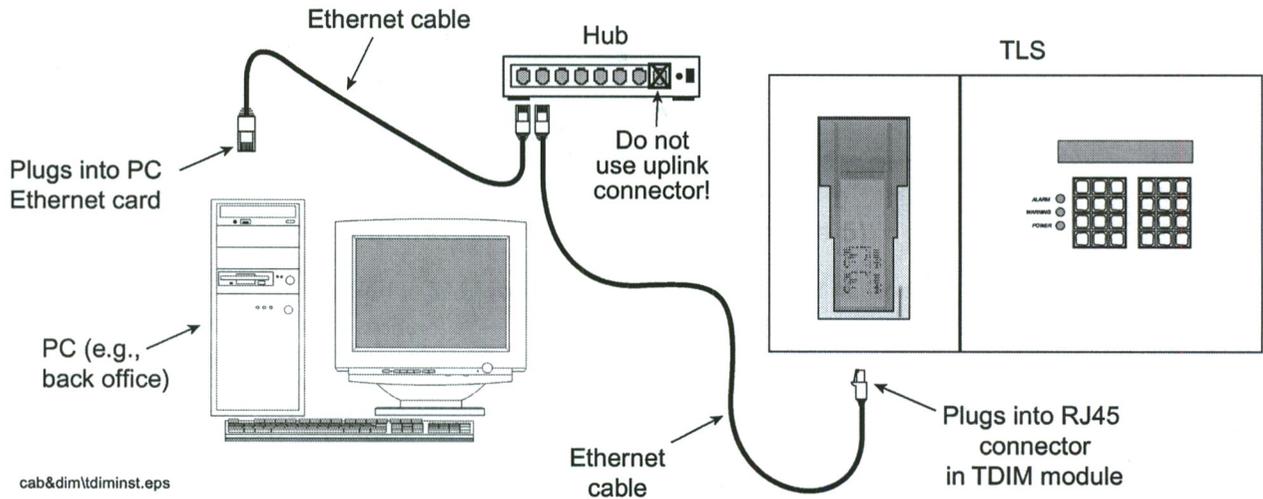


Figure 11. SmartCrind Install

Tokheim Dispensing Systems

- Tokheim Vision 100/200, MEMS IV, or MEMSV controllers
- CFN2 controllers
- ANDI or Columbus controllers
- Schlumberger MicorMax XPIC/DHC
- 67/A - 98 or 67/B controllers

Veeder-Root Software Requirements

- System software Version 17 (or higher)

Veeder-Root Hardware Requirements (see Table 1 on page 5)

Specific DIMS and installation kits are listed in Table 1 on page 5.

Tokheim DHC Requirements

- SCS 1200 default setting for serial port J2
- SCS 9600 default setting for serial port J4
- Version 5, rev 6, dated 11/1989 (or later)

The Tokheim DHC itself can be:

- Standalone (and used with a third party POS). or
- An internal component of a Tokheim Vision 100 Vision 200, MEMS IV, or MEMS V Console

Specific Limitations

Only Tokheim dispensers are supported. Tokheim electronic blenders are supported. The dispensers may feature electronic card readers. Mechanical blenders that blend fuel prior to the metering process are not supported (not a restriction for ISD only applications).

Other POS Consoles

Other POS consoles that interface to the Tokheim DHC may also be supported. Contact Veeder-Root for assistance.

Installation Notes

Connection examples for Tokheim dispenser systems are shown below.

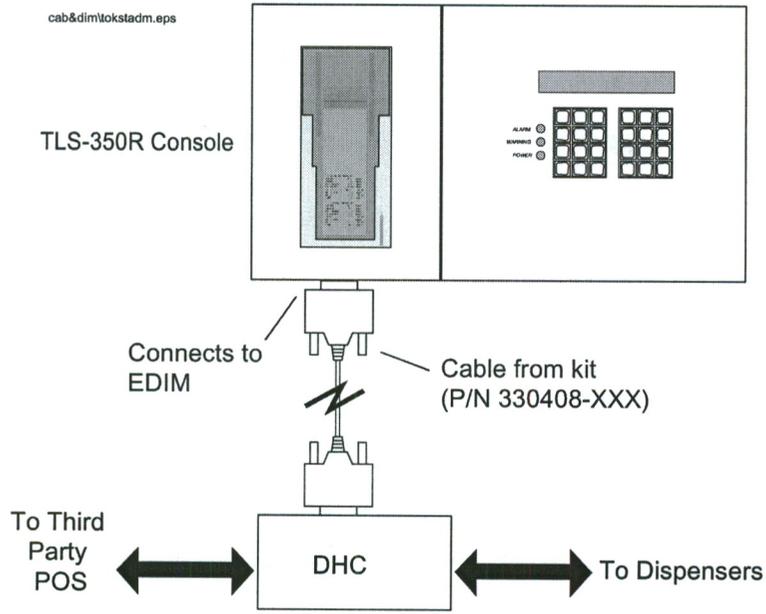


Figure 12. Tokheim DHC Standalone Install

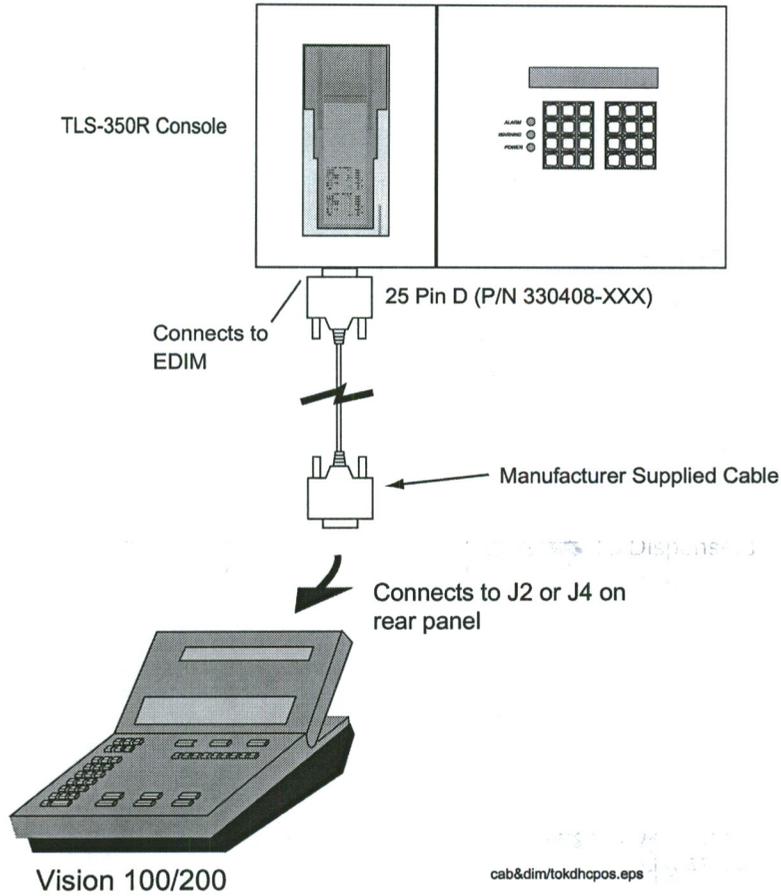


Figure 13. Tokheim Vision 100/200 Install

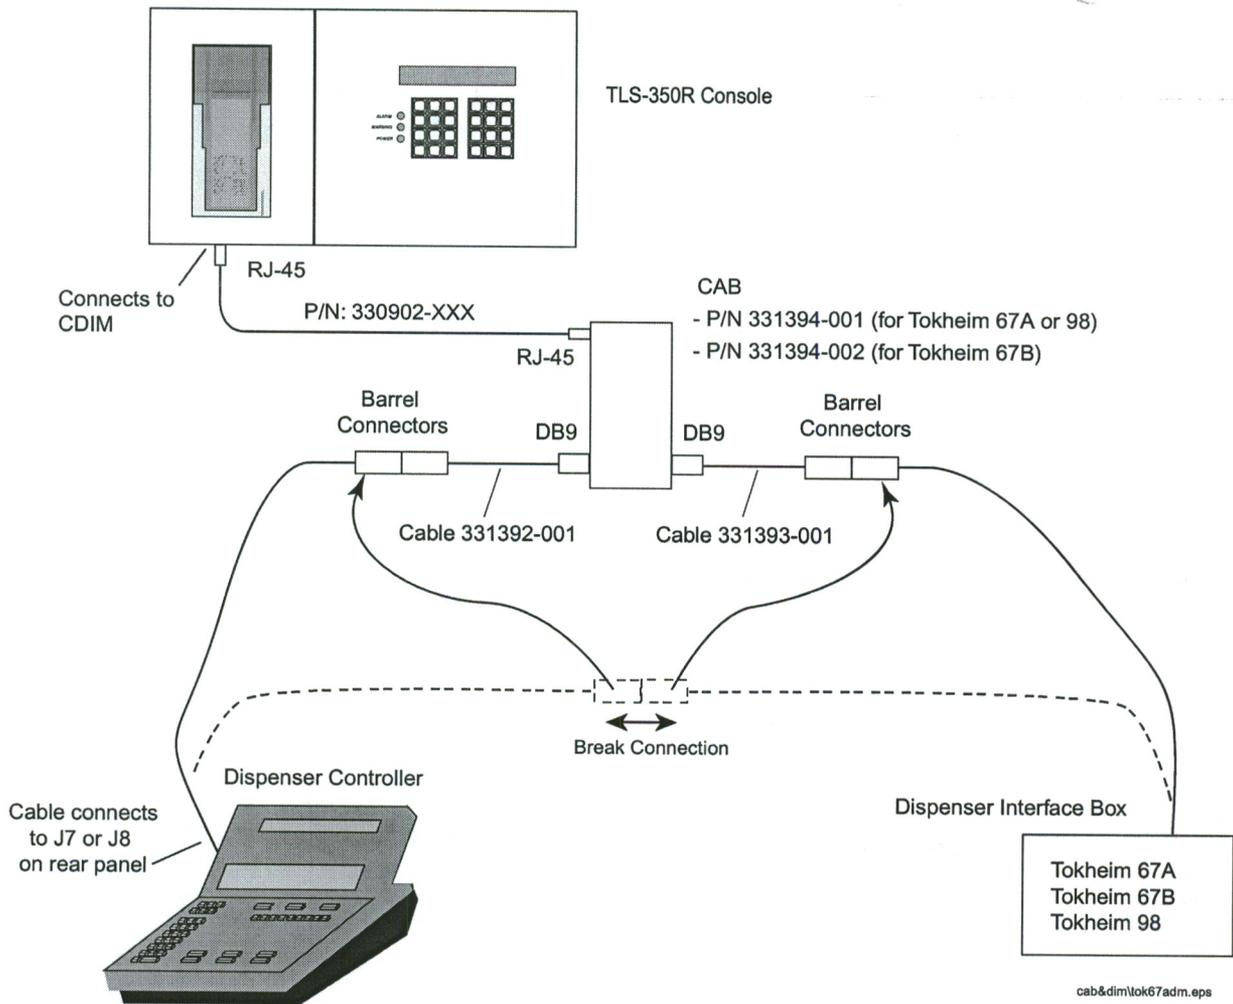


Figure 14. Tokheim Dispenser Controller with Single CAB Install

Wayne Dispensing Systems

Veeder-Root Software Requirements

- System software Version 17 (or higher)
- Peripheral controller software 330269-00B (or higher)

Veeder-Root Hardware Requirements

The required DIMs and installation kits for use with Wayne Dispensing systems are listed in Table 1 on page 5.

POS System Requirements and Limitations

Current Loop Installations

- A Wayne site controller and Wayne dispensers are required.
- Any POS system may be connected to the Wayne site controller.
- The dispensers may feature electronic card readers.

TDIM Installations

- Wayne IDPOS dispenser software 2.29

Supported Wayne Systems

- Wayne 186 System with Site Controller model 880179-001 and Dispenser Data Box (CAB) model DD/SY2400/08.
- Wayne 386 System with Site Controller model WP/SC and Dispenser Data Box (CAB) model WP/DD.
- Wayne IDPOS dispensers

Supported Wayne POS Terminals

- Wayne 186 based 2400
- Wayne 186 based Plus 2
- Wayne 186 based Plus 3
- Wayne 386

In addition, third party POS vendors supply POS systems that interface to Wayne Site Controllers and dispensers. The Wayne DIM supports POS systems that interface to the Site Controller using a Wayne Pump Interface Board (PIB). A partial list of these systems include:

- GasBoy
- Omron
- Panasonic
- S.A.S.I.]
- Suntronics
- Verifone
- EDS C-Serve

The third party POS system will be supported by the Veeder-Root DIM if it communicates to the Wayne Site Controller using the Wayne PIB.

Installation Notes

All Wayne electronic blenders are supported.

An example Wayne interconnection diagram for current loop installations is shown in Figure 15. An example Wayne connection diagram for IDPOS dispenser installations is shown in Figure 14.

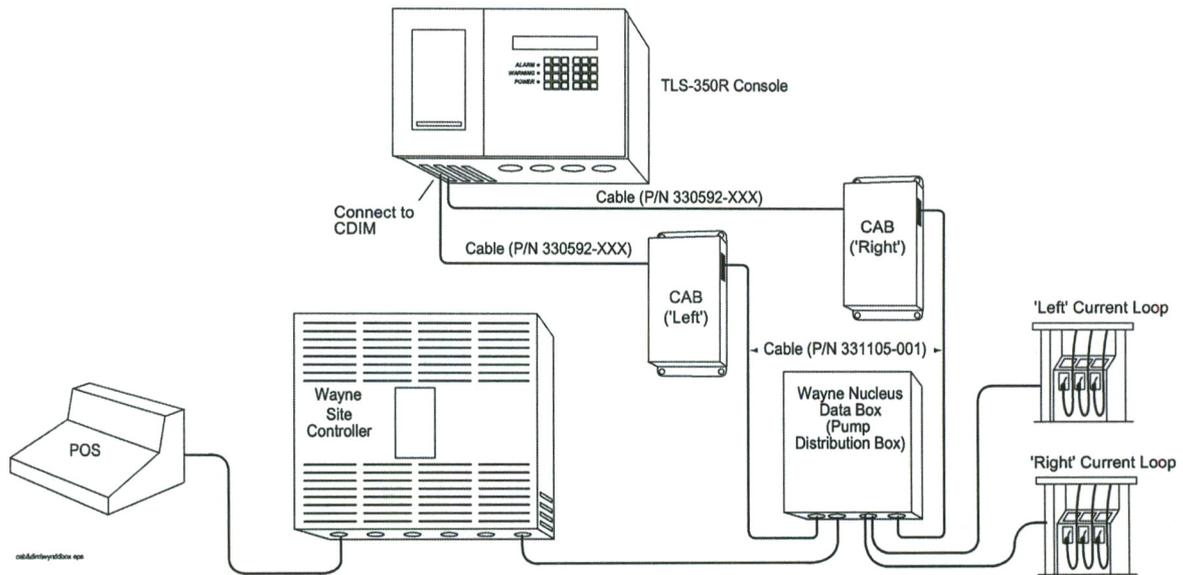


Figure 15. Wayne Dispenser Data Box Current Loop

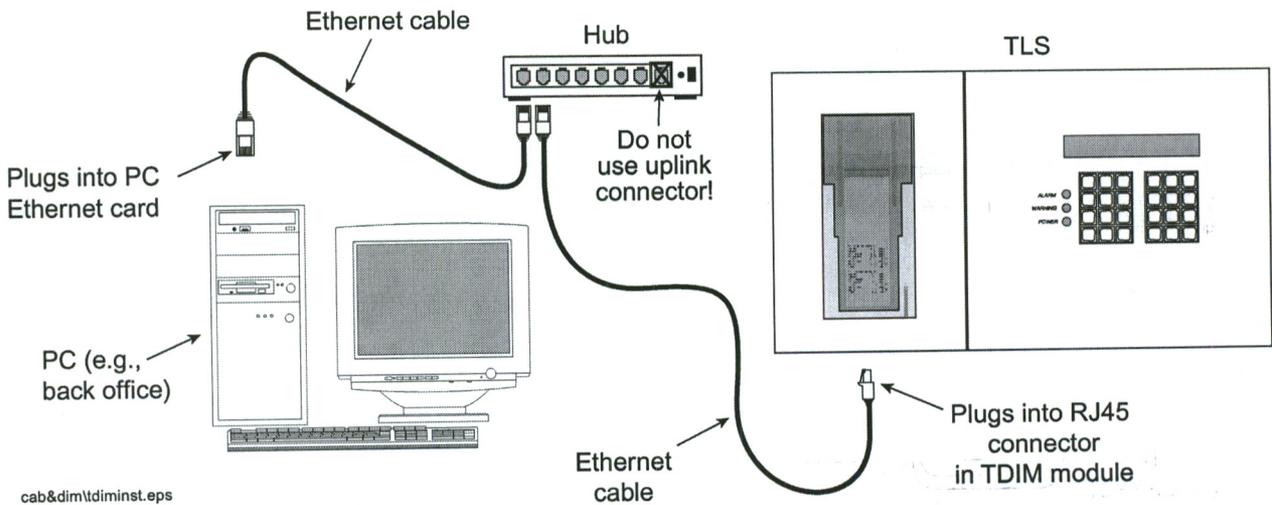


Figure 14. Wayne IDPOS Dispensers

Schlumberger POS Systems

Veeder-Root Software Requirements

- System software Version 17 (or higher)
- Peripheral controller software 002B (of higher)
- DIM software 349633-02A (or higher)

Veeder-Root Hardware Requirements (see Table 1 on page 5)

The following equipment is required to interface the TLS to the Schlumberger POS system:

- One Schlumberger Current Loop Dispenser Interface Module (for up to 32 fueling positions), or One Schlumberger SAM Dispenser Interface Module (for up to 36 fueling positions)
- One installation kit, for one of the following POSs; MicroMax/Allied, Pro Series/XPIC/SAM, or MicroMax/XPIC/DHC

System Limitations

Schlumberger SAM Controllers or Highway systems, are not supported by this DIM. In-dispenser credit readers are supported by the Schlumberger DIM. Blending of any type is not supported by the Schlumberger DIM (not a restriction for ISD only applications).

MicroMax/Allied Hardware Requirements

- An Allied Protocol Box (PCB) or an Allied Station Site Controller (SSC) box.
- Schlumberger MicroMax POS console (other POS terminals are not supported).
- Schlumberger, Gilbarco, Wayne, or Tokheim dispensers may be used.

Installation Notes

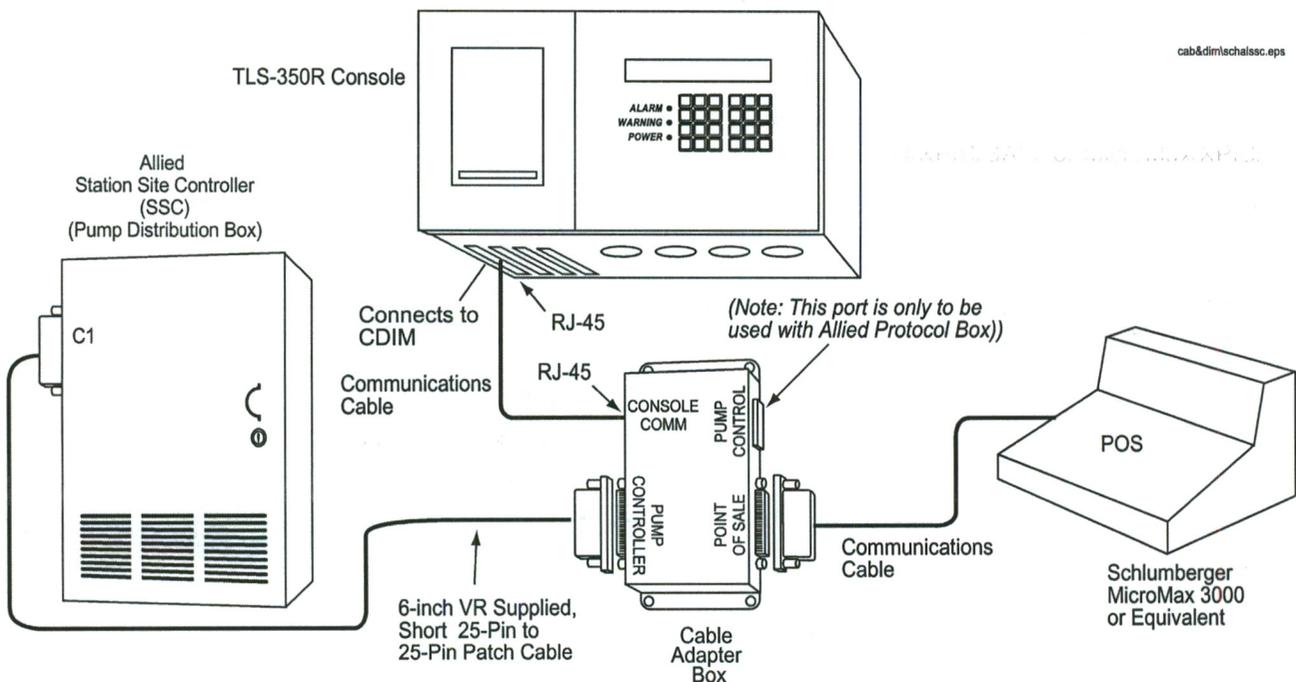


Figure 15. MicroMax POS w/Allied Station Site Controller Box Current Loop Interface

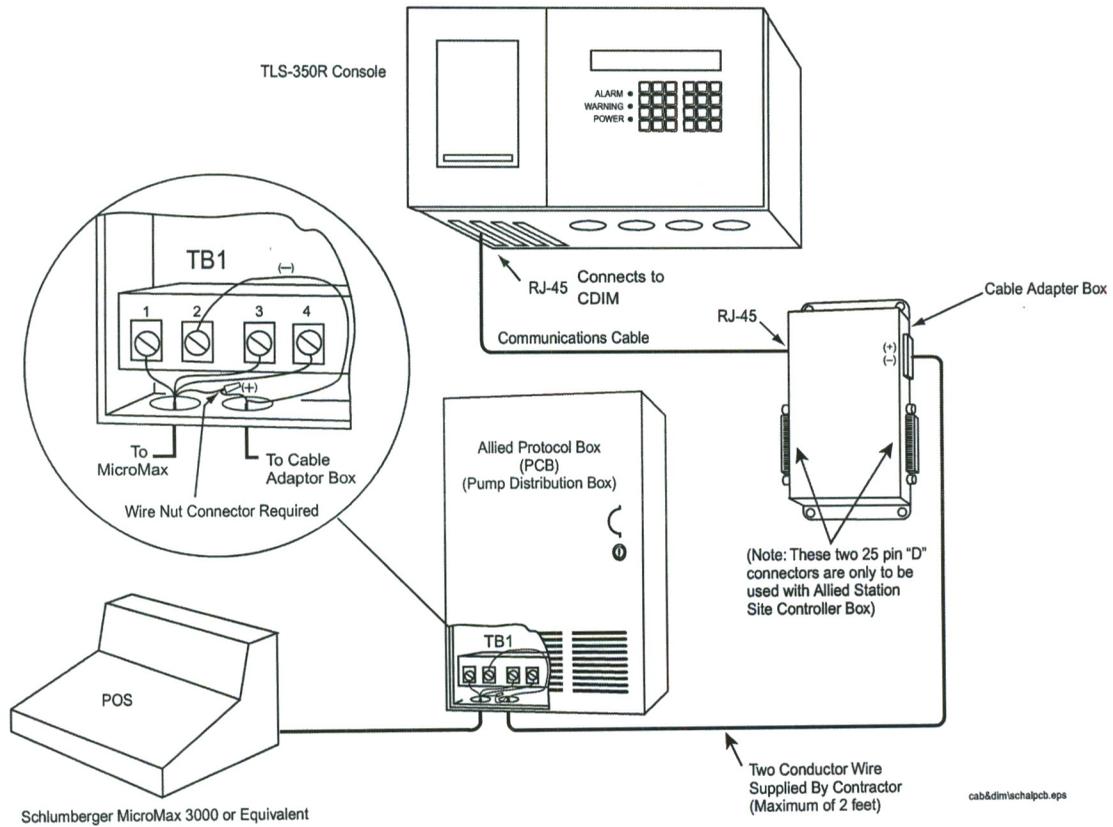


Figure 16. MicroMax POS with Allied Protocol Box Current Loop Interface

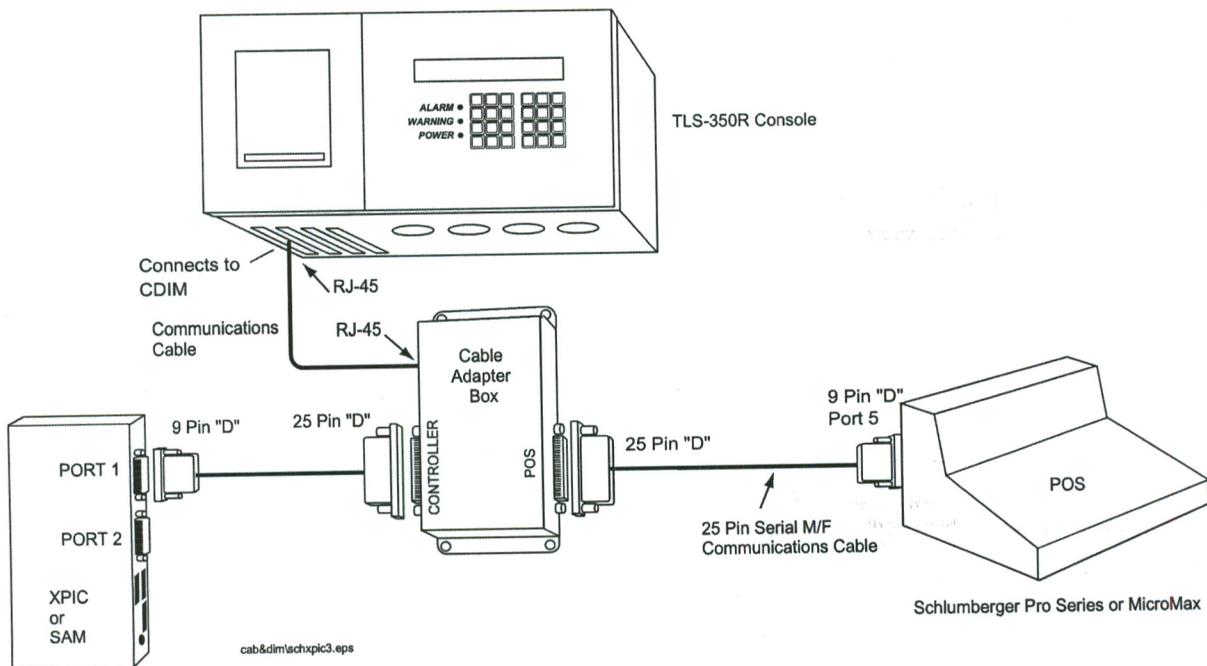


Figure 17. Pro Series or MicroMax POS with SAM or XPIC Controller Box and RS-232 CAB Interface

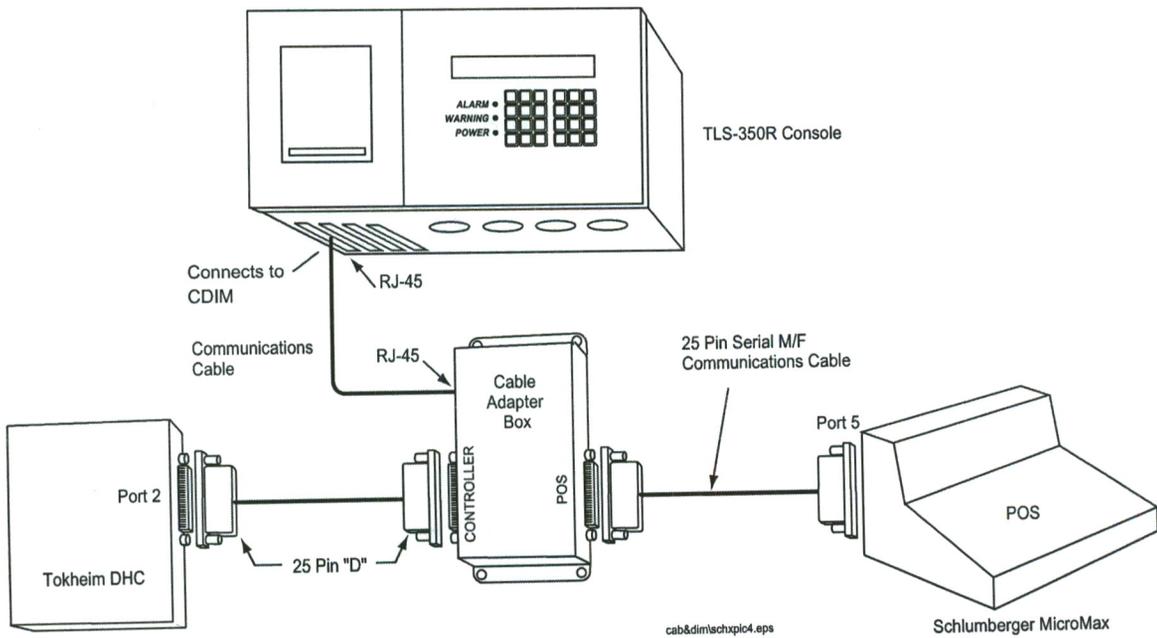


Figure 18. MicroMax POS with Tokheim DHC Controller Box and RS-232 CAB Interface

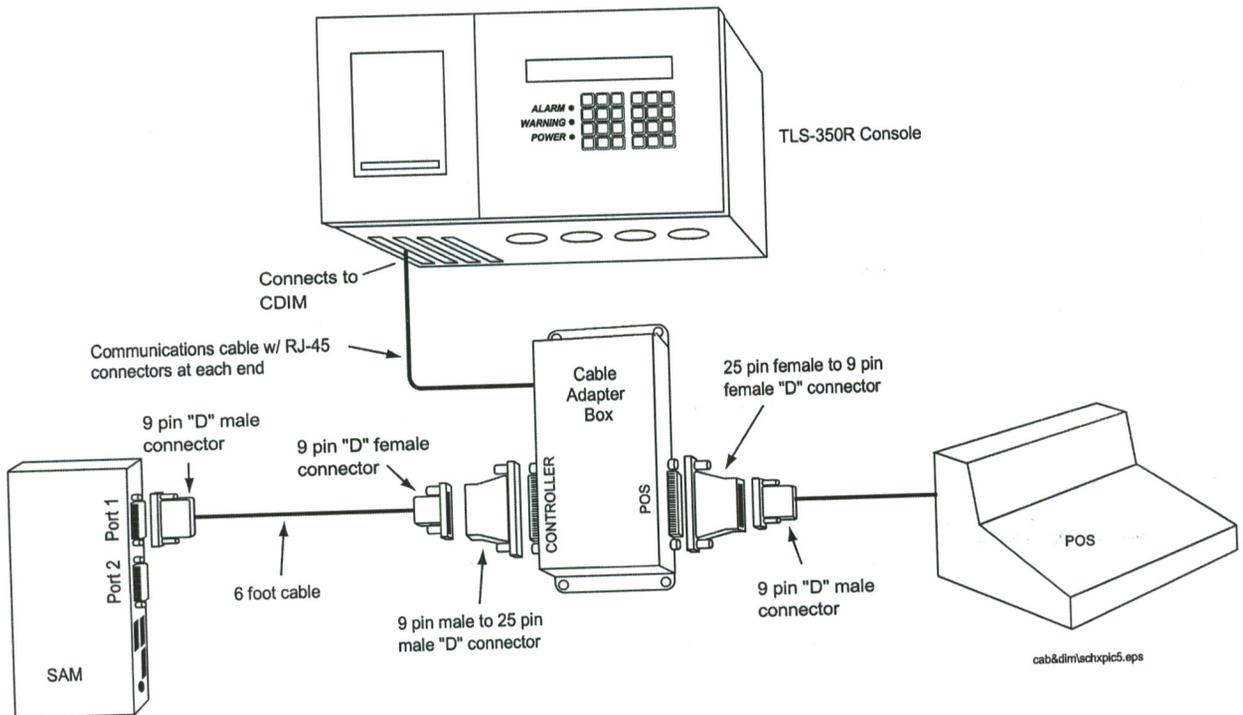


Figure 19. Verifone with SAM and RS-232 CAB Interface

GasBoy CFN Systems

Veeder-Root Software Requirements

System software Version 17 (or higher)

Veeder-Root Hardware Requirements (see Table 1 on page 5)

The following equipment is required to interface the TLS to the Gasboy CFN system:

- One Gasboy Dispenser Interface Module
- One installation kit

GasBoy System Requirements for BIR Interface

- Console must be Site Controller II, version 2.0 or later and have “Send All Messages” feature.
- GasBoy junction box (P/N C05020).
- All Profit Point Broadcast messaging enabled.
- Non-blended dispensers (not a restriction for ISD only applications).

Connecting to the Site Controller II

The TLS-350R must be connected to the Console Loop of the Site Controller II to receive BIR data from the CFN (see Figure 20).

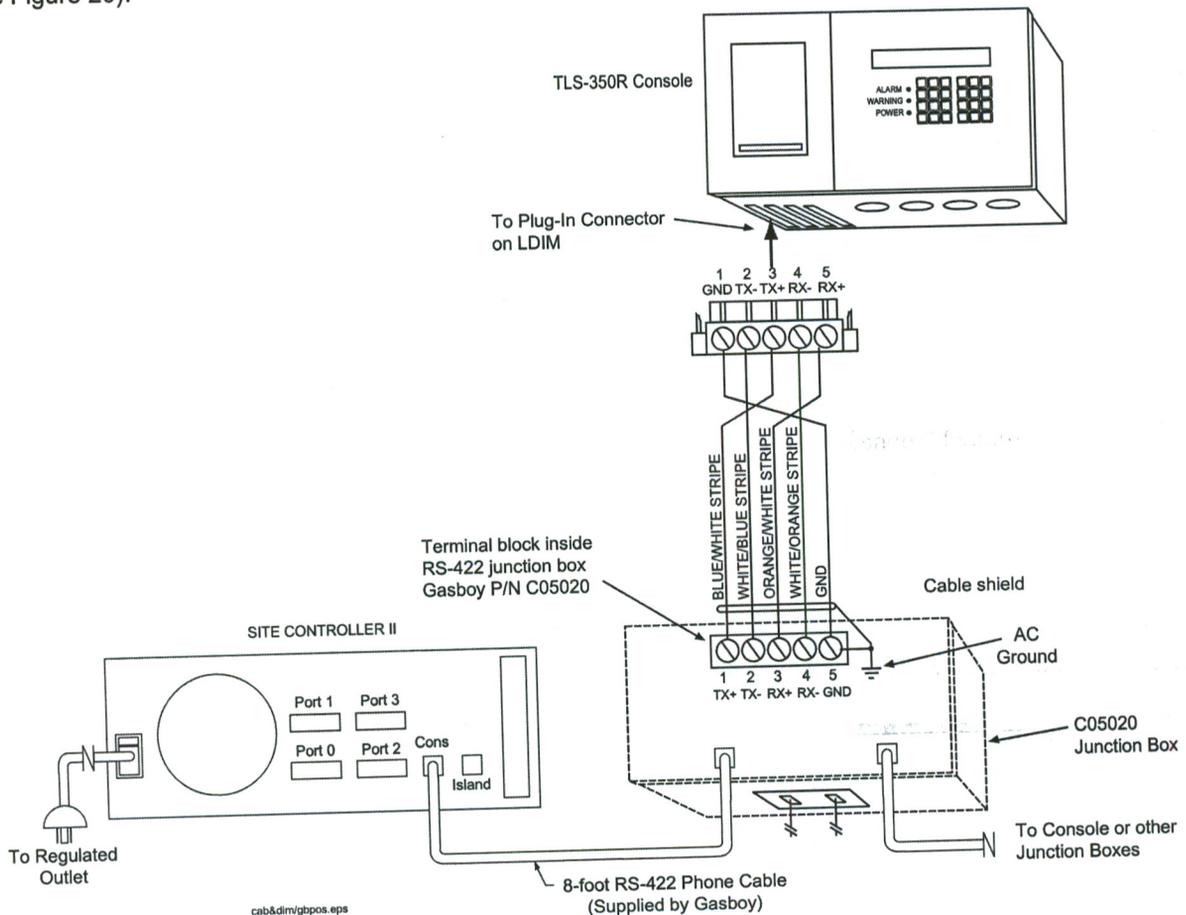


Figure 20. Gasboy Console Loop Connection

BIR Protocol DIM

POS System Requirements and Limitations

Any POS system can conform to established Veeder-Root protocol, to allow the TLS-350R to collect the metered sales data necessary to perform BIR and AccuChart tasks.

This protocol is separate and distinct from the inventory protocol commonly used by POS and other systems to collect inventory data from Veeder-Root TLS consoles.

The following POS systems are known to have implemented the Veeder-Root protocol, and thus support BIR protocol DIM.

Manufacturer	System
Allied	Station Site Controller (SSC)
Gilbarco	T-14 (Australia)
PEC	8850
POSTEC	RCC
Wayne	Marketer 2000 (Sweden)

Mechanical Dispensers

MDIM Applications

Up to 4 single product fueling positions are supported per module, and a maximum of 8 modules (32 fueling positions) per system are supported. Requires a pulser/totalizer or pulse transmitter and a safe barrier device for each fueling position.

Only Veeder-Root mechanical dispensers are supported.

Typical Wiring to Mechanical Dispensers

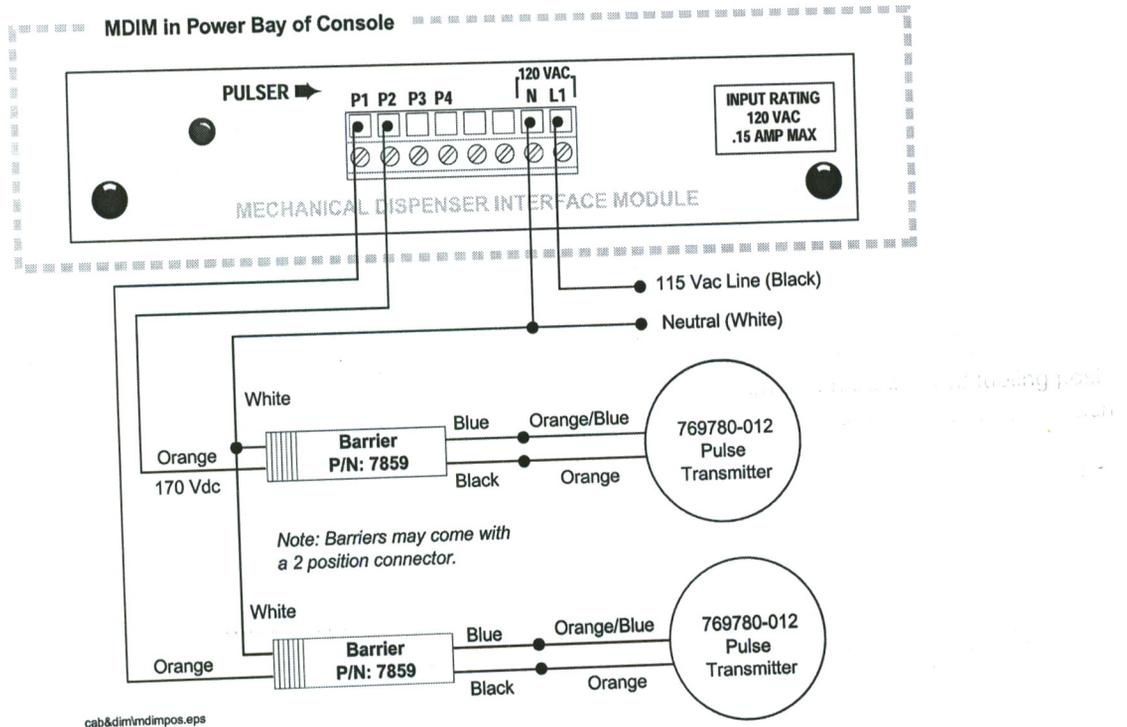


Figure 21. Wiring diagram of MDIM using two 1871/7697 Series Pulse transmitters and required barriers

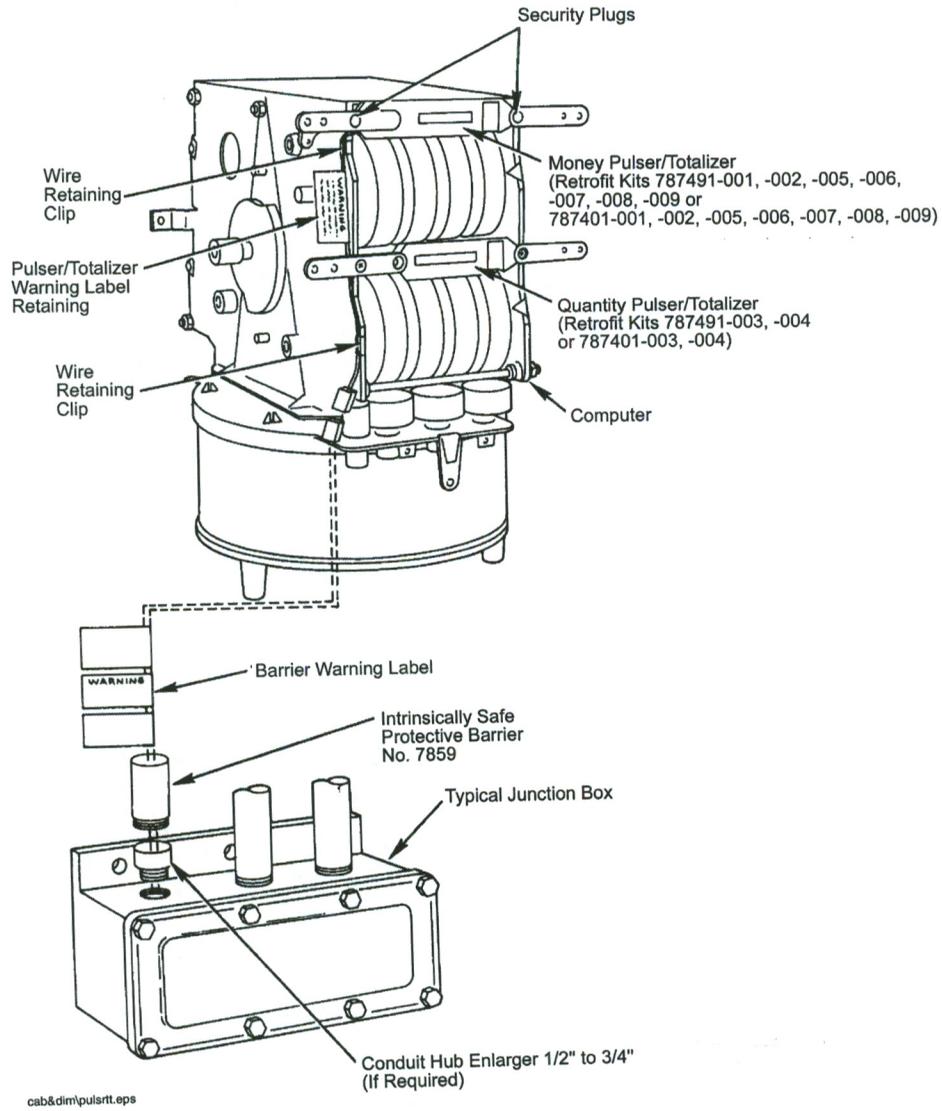


Figure 22. Mechanical Dispenser Applications using 7874 Series Pulser/Totalizer

Typical Wiring for Meter Stand Applications

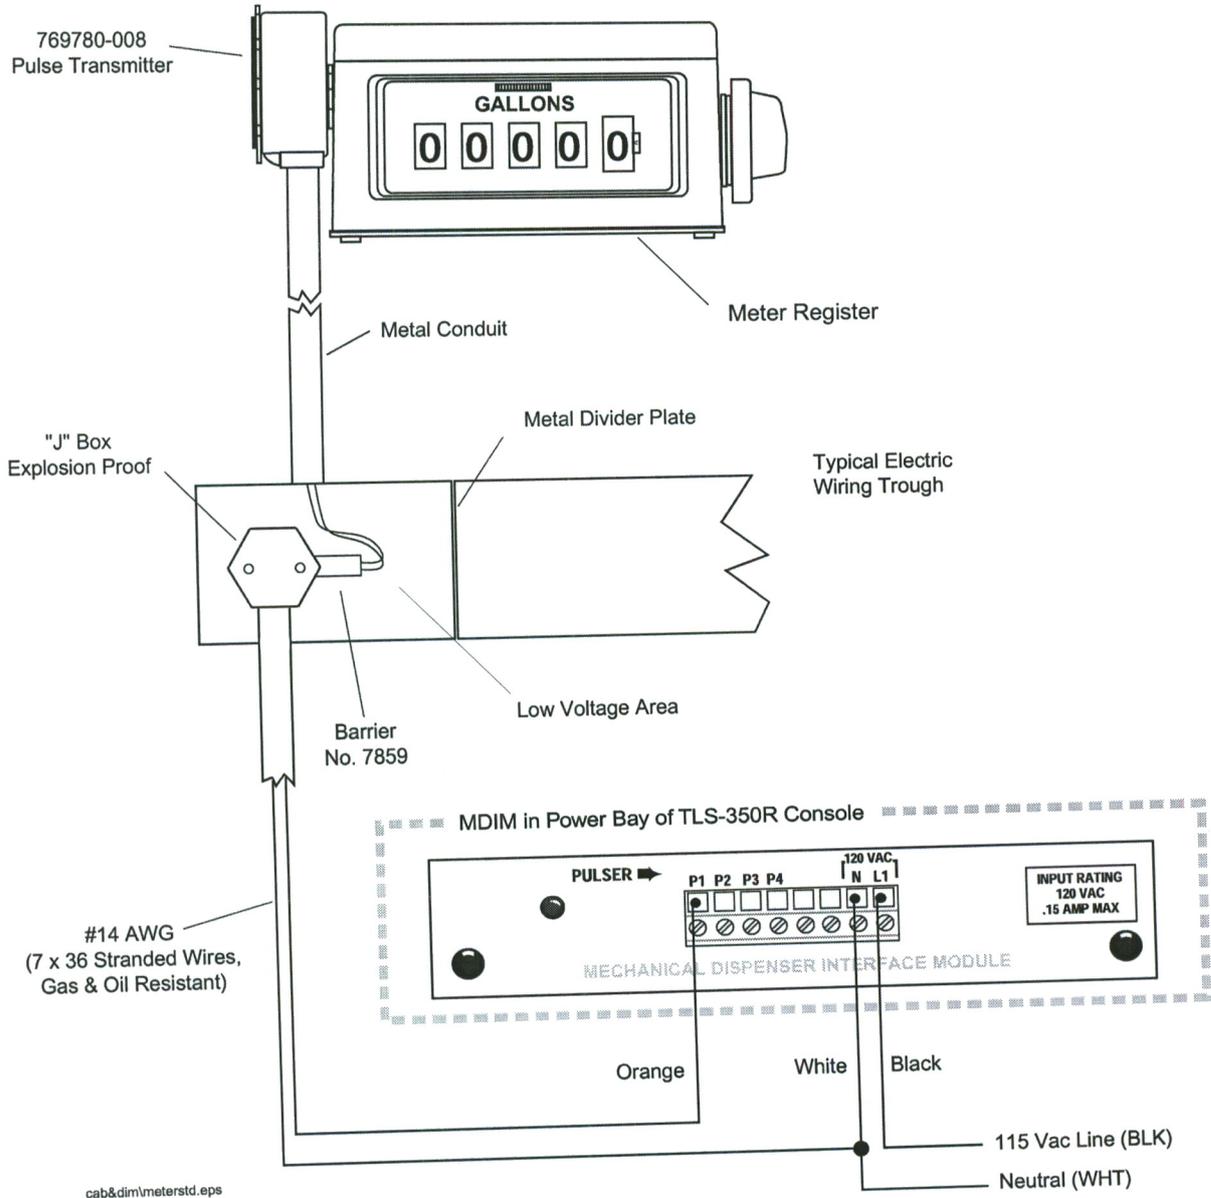


Figure 23. Meter Stand Application Using 1871/7697 Series Pulsar/Totalizer

LVDIM Applications

Up to 4 single product fueling positions are supported per module, and a maximum of 8 modules (32 fueling positions) per system are supported.

PetroVend System 2 Controller

LVDIM is connected to the PV270 pump relay board (in the System 2 controller) and thence to the pulsers (see Figure 24).

PetroVend 4-conductor shielded cable (part no. 12-1026) must be used to connect to pulsers; or you must run #18 AWG gas, oil, and fire-resistant wire in metal conduit (separate from high-voltage wiring) to the pulsers.

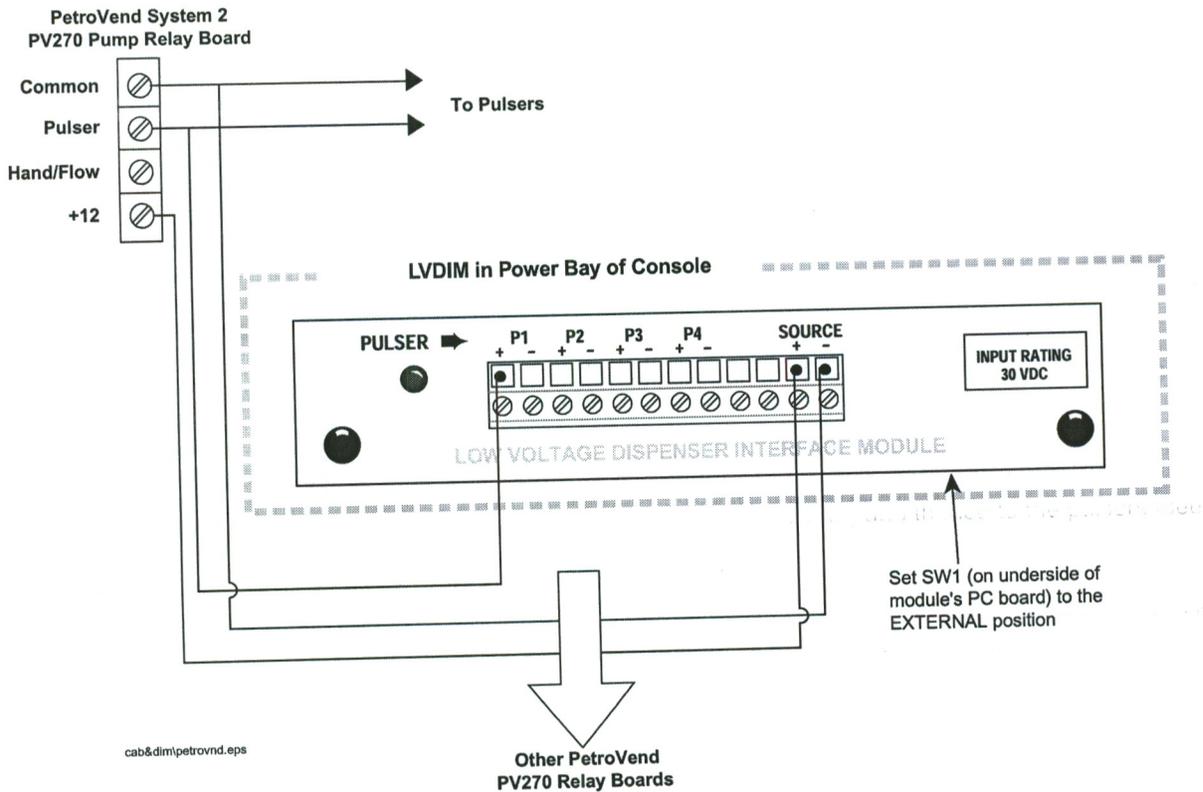


Figure 24. LVDIM Installation with PetroVend System 2 Site Controller

Kraus Micon 200 Electronic Dispensers

Caution! Kraus Micon applications are not U.L. approved.

Each dispenser must provide "volume" pulser output to LVDIM. Installer will have to pull special shielded, UL/CSA type #18 AWG RS-422/485 style, gas, oil, and fire resistant twisted pairs in metal conduit.

LVDIM is connected to the DC junction box inside the Micon 200 electronic dispenser head and thence to the pulsers.

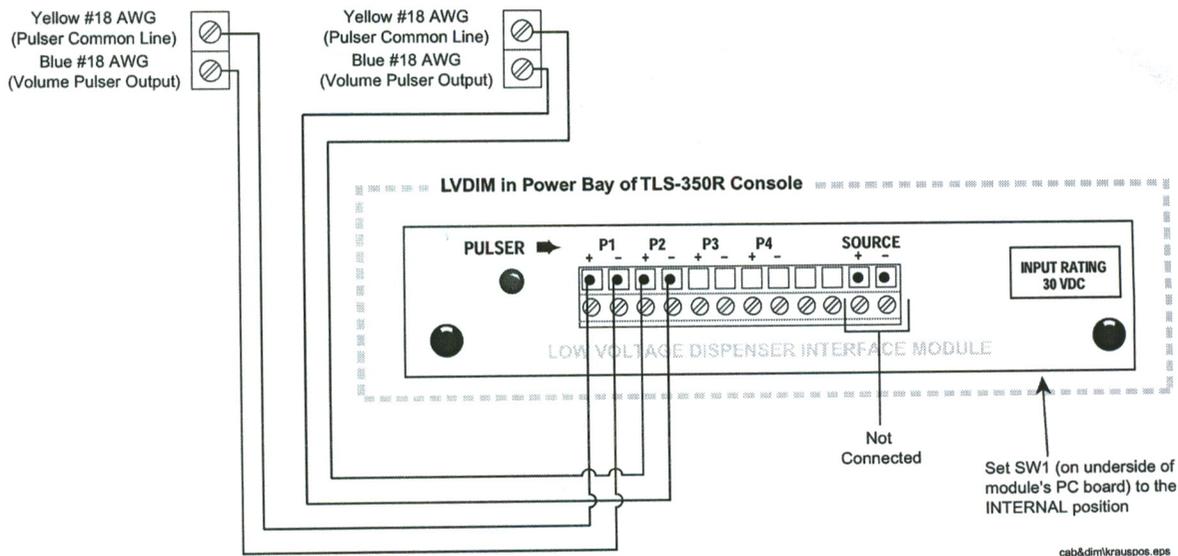


Figure 25. LVDIM Installation Kraus Micon 200 Series Electronic Dispensers (not UL approved)

Wiring to GasBoy 9800 or Tokheim 2600 Series Electronic Dispensers

Special shielded UL/CSA type #18 AWG RS-422/485 style, gas, oil, and fire resistant twisted pairs must be pulled between pulsers and LVDIM module in metal conduit.

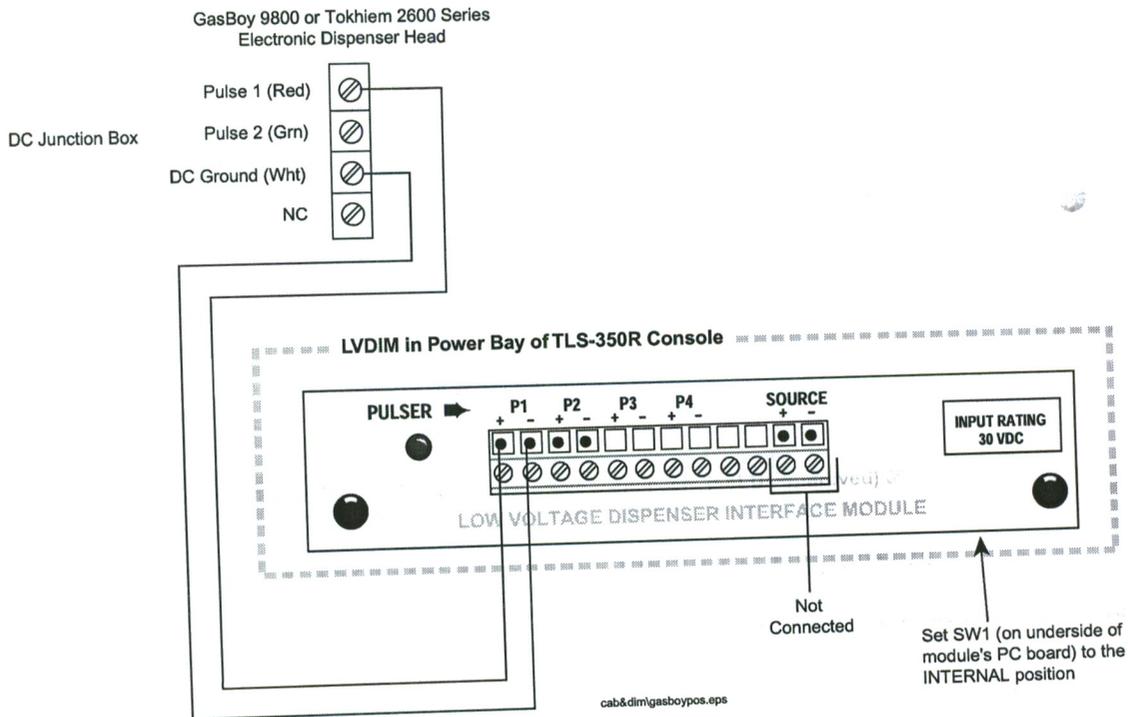


Figure 26. LVDIM Installation with GasBoy 9800 or Tokheim 2600 Series Electronic Dispenser Head



For technical support, sales or
other assistance, please visit:
www.veeder.com